



## **Appendix A**

Air Quality Technical Memorandum

## TECHNICAL MEMORANDUM

To: RPCA Solar 13, LLC  
From: Olivia Chan and Mayra Garcia, Kimley-Horn and Associates, Inc.  
Date: October 30, 2024  
Subject: Sunrise Road Solar Project – Air Quality Technical Memorandum

---

### PURPOSE


The purpose of this memorandum is to assess potential impacts due to air pollutant emissions associated with construction and operation of the Sunrise Road Solar (Project), proposed to be located in unincorporated San Bernardino County (County), California.

### PROJECT LOCATION

The Project Site is located along the western boundary of the County and is approximately 0.25 miles east of the census-designated place of Boron in Kern County (see **Figure 1: Regional Vicinity Map**). The Project would occupy approximately 59 acres (Project Site) across two 40-acre parcels (County Assessor Parcel Number [APNs] 0498-111-04 and 0498-111-05) generally located at Twenty Mule Team Road. As shown in **Figure 2: Local Vicinity Map**, the Project Site is bordered by North San Bernardino Boulevard to the west and undeveloped open space to the north, east, and south. Regional access to the Project Site is provided via State Route 58 (SR 58) to the north and east and Old Highway 58 to the east. Local access to the Project Site would be provided via North San Bernardino Boulevard located along the western Project Site boundary and Twenty Mule Team Road approximately 230 feet to the south.


### PROJECT DESCRIPTION

RPCA Solar 13, LLC (Applicant) proposes to construct and operate a single-axis tracker ground-mounted photovoltaic (PV) community solar facility and battery energy storage system (BESS) with approximately 14 megawatts of alternating current (MWac) in capacity. The Project is proposed to be located on two privately-owned parcels located in unincorporated San Bernardino County (County). The Applicant is requesting Conditional Use Permit (CUP) approval from the County to construct the following components: solar modules, BESS, underground electrical conductors, Balance of System Equipment, access roads, and fencing. The Project would be interconnected to an electrical distribution system owned by Southern California Edison (SCE) located adjacent to the southern Project Site boundary.

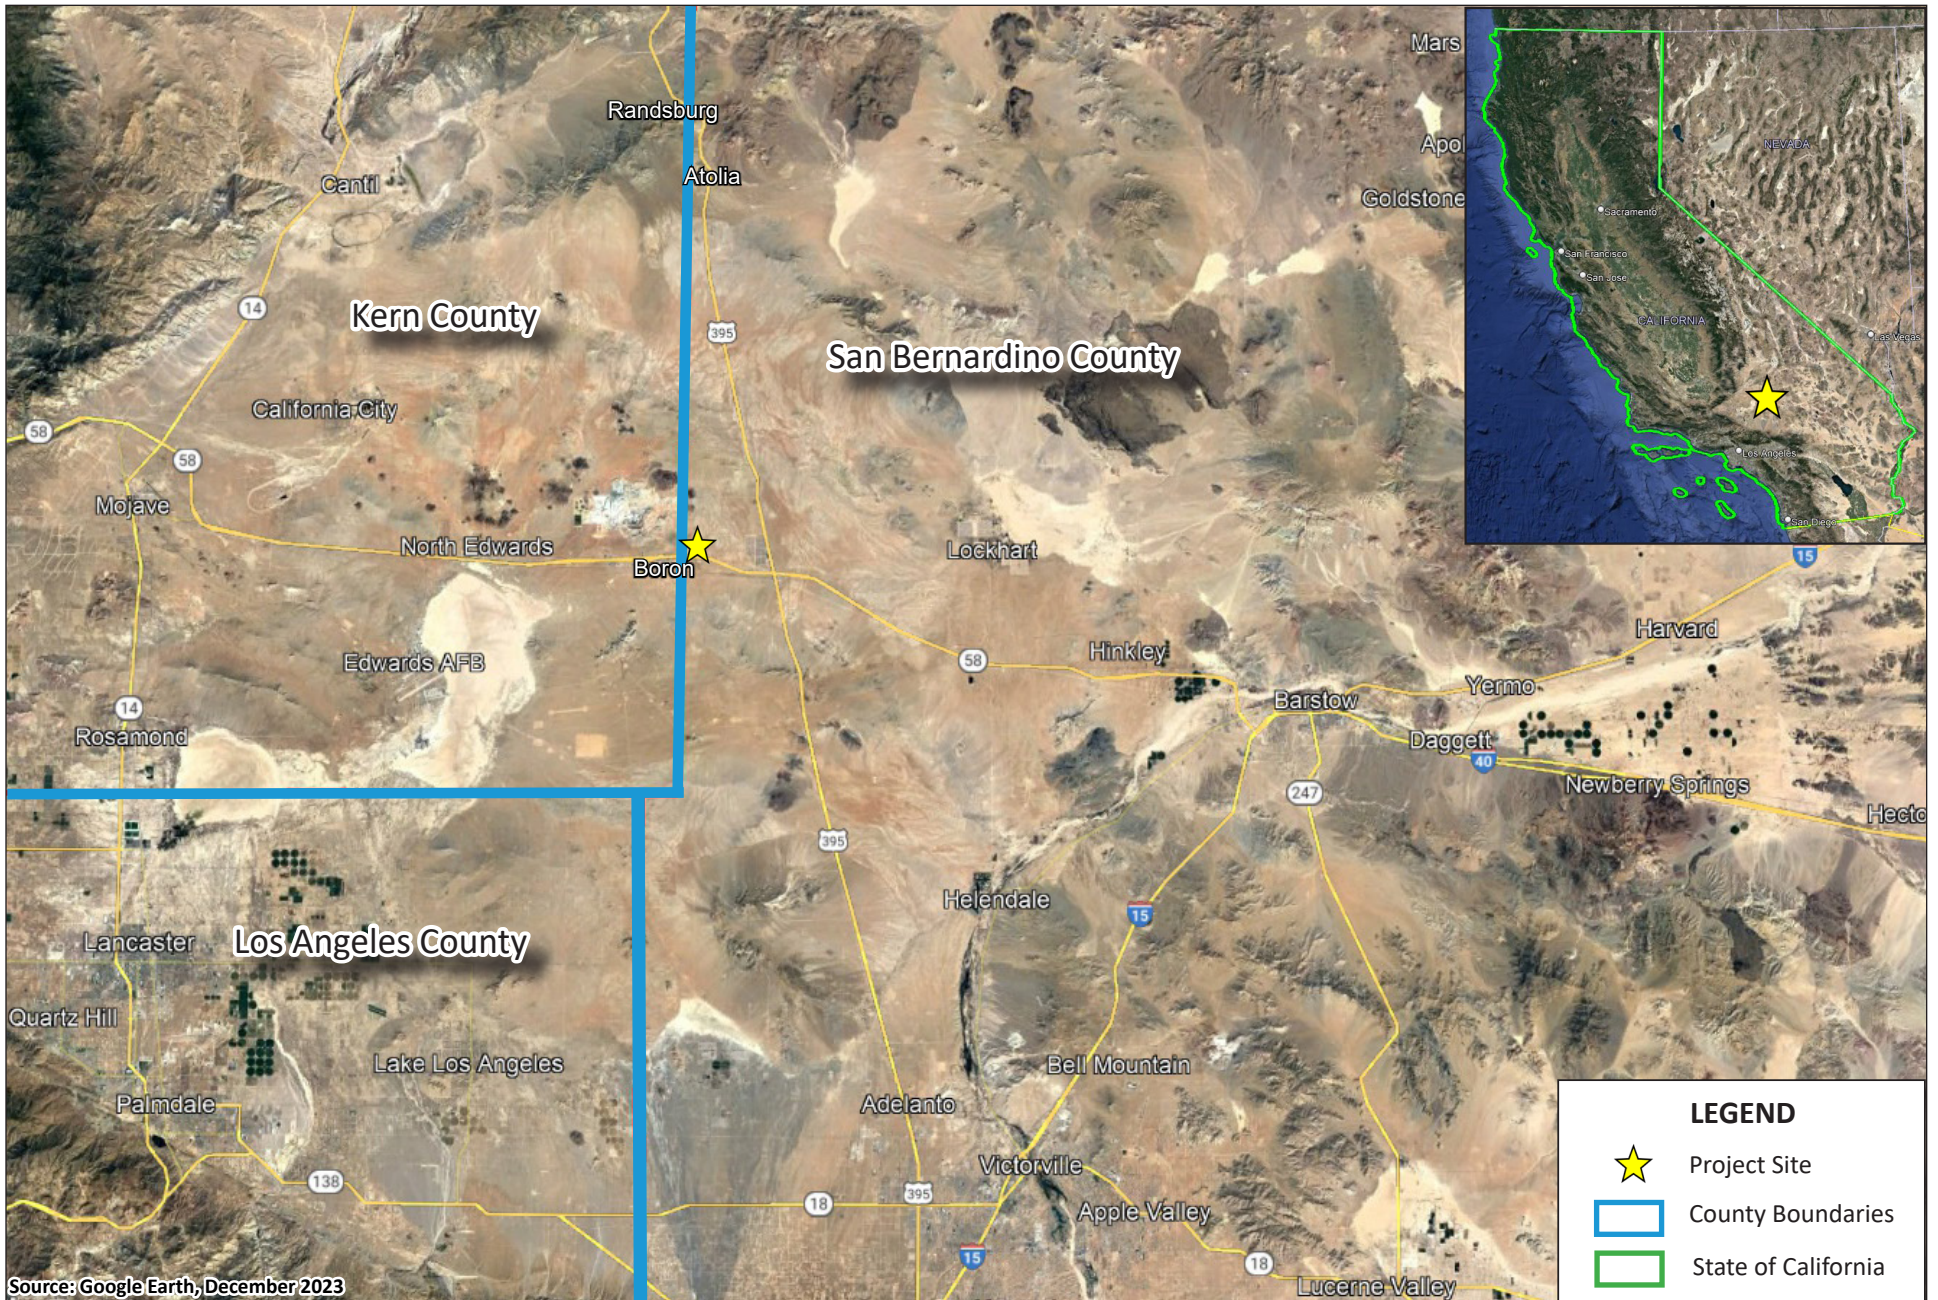

**Figure 1: REGIONAL VICINITY MAP**  
 Sunrise Road Solar Project  
 Initial Study/Mitigated Negative Declaration



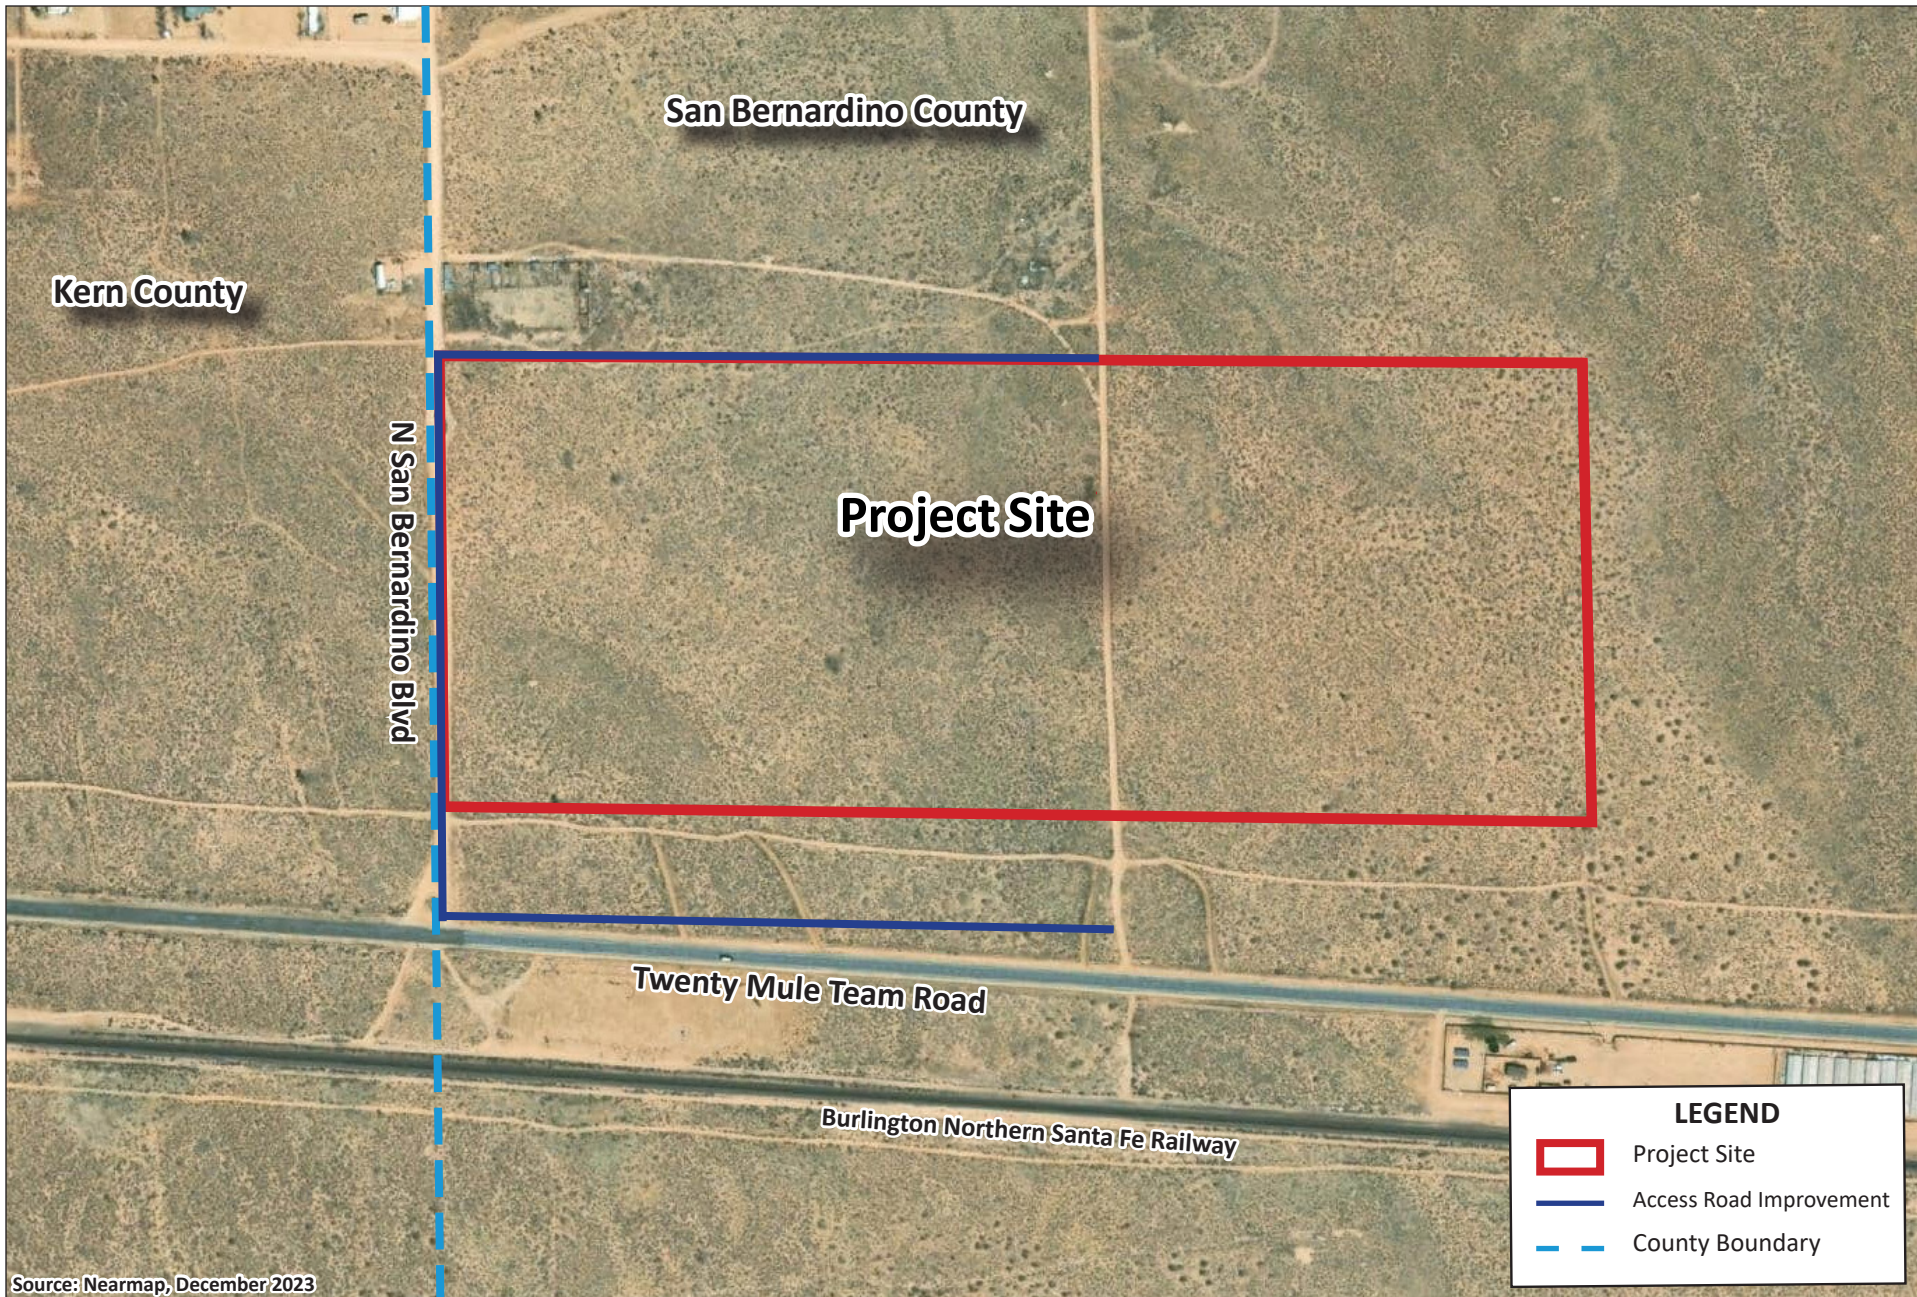

Source: Nearmap, December 2023

**Figure 2: LOCAL VICINITY MAP**

Sunrise Road Solar Project

Initial Study/Mitigated Negative Declaration



**Kimley»Horn**

The Project would include solar modules and string inverters. The modules would be manufactured off-site and delivered by truck in wooden crates or cardboard boxes. The solar modules would be fully enclosed in metal and glass frames and would rotate throughout the day to maximize sun exposure. The frames of solar modules would be mounted on steel posts, which would be driven or screwed into the ground to a depth between 10 and 15 feet. The posts would be made from galvanized or corrosion-resistant metal to minimize the potential for corrosion-resistant metal to minimize the potential for corrosion over the lifespan of the Project. The foundations securing the solar modules would be designated to withstand high winds and snow loads. To protect equipment from potential ponding or overland stormwater flow, all equipment skids and pads would be elevated at a minimum of 12 inches above the 100-year flood elevation. The overall height of the solar array would be no more than 15 feet tall.

The BESS would store electrical energy produced by the Project during the day and flexible dispatch it to the grid when it is most needed, typically in the evening. The BESS would be comprised of four battery banks located in the southeast corner of the PV array on a gravel pad. Each battery bank would be approximately the size of a standard shipping container. The BESS would include redundant safety measures, such as hydrogen detection, active ventilation, fire detection and remote shutdown, fireproof insulation, and internal fire suppression technology.

The Balance of System Equipment, including, but not limited to, inverters, AC combiner boxes, transformers, and/or medium voltage switchgear may be installed near the solar array within the Project's fence line. The Balance of System Equipment would be installed on H-Frames and concrete pads and in compliance with equipment manufacturer instructions. Low voltage conductors connecting the solar modules to the Balance of System Equipment would be run underground in conduit. The medium voltage conductors would mostly run underground in a similar fashion to low voltage wiring. A portion of the medium voltage conductor would ultimately come above ground and be strung along new distribution poles on the Project Site, ultimately terminating at the electrical distribution system along the unnamed dirt road bordering the southern boundary of the Project Site, maintained by SCE.

Site access would be provided from Twenty Mule Team Road via an access road extending from the south of the Project Site along the western boundary and to the east (see Figure 2 above). While the road may be a combination of graded dirt or gravel, for purposes of the analysis, the road is assumed to be paved to account for worst-case scenario construction emissions. The road improvement may extend up to approximately 1 mile long. Where necessary, the access roads would be upgraded using gravel and geotextile fabric and extended into the Project's fence line. The access roads would encircle the entire solar array and bisect the Project Site in an east-west orientation. The roads would be wide enough to accommodate emergency vehicles (20 feet wide and 15 feet wide for the perimeter and internal access roads, respectively) and designed in compliance with County building and fire department standards. Approximately 11 feet of space would be maintained between each row of solar modules for operations and maintenance access. The access roads would be placed such that

the farthest panel is no further than 330 feet from the center of the fire road and would connect directly to the BESS.

The Project would be enclosed in a six-foot-tall chain link fence with one foot of barbed wire on top (for a total fence height of 7-feet) in compliance with the National Electric Code. The fence would have at least one vehicle access gate at the boundary of the array. The vehicle access gate would remain locked, except during operations and maintenance activities. The Project proposes a 10-foot landscape buffer beyond the fence on the western and southern boundaries of the Project Site to screen the Project from nearby motorists on North San Bernardino Avenue and Twenty Mule Team Road, respectively. A Knox box would be installed at the entrance gate to provide two hour access for emergency responders.

### Construction

Project construction is anticipated to be completed over a period of approximately nine months beginning as early as September 2025 and ending as early as May 2026. Project construction activities generally fall into seven main categories: (1) access road construction, (2) demolition, (3) site preparation (vegetation clearing), (4) grading, (5) paving, (6) system installation, and (7) testing, commissioning, and cleanup.<sup>1</sup> The on-site construction workforce is expected to peak at approximately 70 individuals during the construction period. Construction personnel will be divided between civil and electrical services.

### Operations

The first full year of facility operation is expected to be 2026. The Project would operate year-round. The Project would be unmanned, and no employees would report to the Project Site daily. Typical operations and maintenance (O&M) activities during Project operations include, but are not limited to, facility monitoring; administration and reporting; remote operations of inverters, BESS system, and other equipment; repair and maintenance of solar facilities; and periodic panel and inverter washing. It is estimated that the Project would require 6 maintenance-related visits per year and up to 4 solar panel and inverter washing visits per year, resulting in a total of approximately 10 operational round trips per year (20 one-way trips).

During Project O&M, it is anticipated that minimal water would be required for solar panel washing. Water consumption for washing panels is expected to be approximately 0.3 acre-feet (AF) of water per year, and all water would be trucked in from an offsite source. Water washing is by deluge and no chemicals or other materials are used.

---

<sup>1</sup> Note that the modeling does not account for testing, commissioning, and cleanup as heavy-duty construction equipment would not be utilized.

### Decommissioning

At the end of the Project's operational term, which is expected to be 35 years, the Applicant may determine that the Project should be decommissioned and deconstructed. The Applicant will work with the County to ensure decommissioning complies with all applicable local, State, and federal requirements and best management practices (BMPs). The Project would include BMP to ensure the collection and recycling of modules and to avoid the potential for modules to be disposed of as municipal waste. Pursuant to San Bernardino County Development Code Section 84.29.070 (Decommissioning Requirements), following the operational life of the Project, the Project owner shall perform site closure activities to meet federal, State, and local requirements for the rehabilitation and revegetation of the Project Site after decommissioning.

Equipment would be de-energized prior to removal, salvaged (where possible), placed in appropriate shipping containers, and secured in a truck transport trailer for shipment off site to be recycled or disposed of at an appropriate licensed disposal facility. Site infrastructure would be removed including fences and concrete pads that may support the inverters and related equipment. The exterior fencing would be removed and materials would be recycled to the extent feasible. Project internal and access roads would be restored to their pre-construction condition to the extent feasible unless the landowner elects to retain the improved roads for access throughout the property. A collection, reuse, and recycling program would be utilized to promote reuse and recycling of Project components and minimize disposal in landfills.

## **ENVIRONMENTAL SETTING**

### **Regional Topography**

The State of California is divided geographically into 15 air basins, generally along geographic or topographic boundaries. The Project Site is located in the Mojave Desert Air Basin (Basin). The Basin includes the desert portion of Los Angeles and San Bernardino Counties, the eastern desert portion of Kern County, and the northeastern desert portion of Riverside County. The Mojave Desert Air Quality Management District (MDAQMD) has jurisdiction over stationary sources of air pollution located within San Bernardino County's High Desert and Riverside County's Palo Verde Valley, which includes the Project Site.

The Basin is bound in the northwest by the Tehachapi Mountains, in the southwest by the San Gabriel Mountains, and in the south by the San Bernardino Mountains. To the north, the Basin is defined by the San Bernardino-Inyo County boundary, to the northeast the California-Nevada state line, and to the east by the Colorado River. The San Gabriel and San Bernardino Mountains are high and rugged, with the highest peaks being 10,066 feet above sea level (Mt. San Antonio) and 11,503 feet (Mt. San Gorgonio), respectively. The Basin generally lies at 3,000 to 6,000 feet elevation.

The Mojave Desert is situated in a transitional zone between the Great Basin Desert to the north and the Sonoran Desert to the south (mainly between 34°N and 38°N latitudes). The area is primarily a

rain-shadow desert, meaning it experiences little rainfall because it is sheltered from prevailing rain-bearing winds (i.e., off the Pacific Ocean) by a range of mountains.

### **Meteorology and Climate**

Factors such as wind, sunlight, temperature, humidity, and rainfall, affect the accumulation and/or dispersion of air pollutants throughout the Basin. Local meteorological conditions are greatly affected by the topography of the region.

Prevailing winds in the Basin are out of the west and southwest. These prevailing winds are due to the proximity of the Basin to coastal and central regions and the blocking nature of the Sierra Nevada Mountains to the north. Air masses pushed onshore in Southern California by differential heating are channeled through the mountain passes. Although a portion of the prevailing winds come from the Los Angeles Basin via the canyons, the vast majority of the winds are a result of the orographic effect and the desert heat low-pressure systems. The “orographic effect” is the phenomenon whereby the air is forced over the mountain range and loses moisture as it rises. When it descends, it also compresses and heats up. The speed of the wind is aided by the “desert heat low”, which routinely form over the eastern Mojave Desert area. During the summer a Pacific Subtropical High Cell, that sits off the coast generally influences the Basin, inhibiting cloud formation and encouraging daytime solar heating. The Basin is rarely influenced by cold air masses moving south from Canada and Alaska, as these frontal systems are weak and diffuse by the time they reach the desert. Most desert moisture arrives from infrequent warm, moist, and unstable air masses from the south. The Basin averages between three and seven inches of precipitation per year (from 16 to 30 days with at least 0.01 inches of precipitation). The Basin is classified as a dry-hot desert climate, with portions classified as dry-very hot desert, to indicate at least three months have maximum average temperature over 100.4° F.<sup>2</sup>

### **Criteria Air Pollutants**

Carbon Monoxide (CO). Carbon monoxide is a colorless and odorless gas formed by the incomplete combustion of fossil fuels. CO is emitted almost exclusively from motor vehicles, power plants, refineries, industrial boilers, ships, aircraft, and trains. Automobile exhaust accounts for most CO emissions. CO is a nonreactive air pollutant that dissipates relatively quickly; therefore, ambient CO concentrations generally follow the spatial and temporal distributions of vehicular traffic. Concentrations are influenced by local meteorological conditions, primarily wind speed, topography, and atmospheric stability. CO from motor vehicle exhaust can become locally concentrated when surface-based temperature inversions are combined with calm atmospheric conditions. The highest levels of CO typically occur during the colder months of the year when inversion conditions are more frequent. In terms of health, CO competes with oxygen, often replacing it in the blood, thus reducing

---

<sup>2</sup> Mojave Desert Air Quality Management District, California Environmental Quality Act (CEQA) and Federal Conformity Guidelines, February 2020.



the blood's ability to transport oxygen to vital organs. The results of excess CO exposure can be dizziness, fatigue, and impairment of central nervous system functions.

Ozone (O<sub>3</sub>). Ozone is a colorless gas that is formed in the atmosphere when volatile organic compounds (VOCs), sometimes referred to as reactive organic gases (ROGs), and nitrogen oxides (NO<sub>x</sub>) react in the presence of ultraviolet sunlight. Ozone is not a primary pollutant; it is a secondary pollutant formed by complex interactions of the two precursor pollutants directly emitted into the atmosphere. Automobile exhaust and industrial sources are the primary sources of VOCs and NO<sub>x</sub>. Meteorology and terrain play major roles in O<sub>3</sub> formation. Ideal conditions occur during summer and early autumn on days with low wind speeds or stagnant air, warm temperatures, and cloudless skies. Ozone can damage the tissues of the respiratory tract, causing inflammation and irritation, and result in symptoms such as coughing, chest tightness, and worsening of asthma symptoms.

Nitrogen Dioxide (NO<sub>2</sub>). Most NO<sub>2</sub>, like O<sub>3</sub>, is not directly emitted into the atmosphere but is formed by an atmospheric chemical reaction between nitric oxide (NO) and atmospheric oxygen. NO and NO<sub>2</sub> are collectively referred to as NO<sub>x</sub> and are major contributors to ozone formation. High concentrations of NO<sub>2</sub> can cause breathing difficulties and result in a brownish-red cast to the atmosphere with reduced visibility. There is some indication of a relationship between NO<sub>2</sub> and chronic pulmonary fibrosis. Some increase in bronchitis in children (2 and 3 years old) has also been observed at concentrations below 0.3 parts per million (ppm) by volume.

Particulate Matter (PM<sub>2.5</sub> and PM<sub>10</sub>). Particulate matter pollution consists of very small liquid and solid particles floating in the air, which can include smoke, soot, dust, salts, acids, and metals. Particulate matter can form when gases emitted from industries and motor vehicles undergo chemical reactions in the atmosphere. PM<sub>2.5</sub> and PM<sub>10</sub> represent fractions of particulate matter. Fine particulate matter, or PM<sub>2.5</sub>, is roughly 1/28 the diameter of a human hair. PM<sub>2.5</sub> results from fuel combustion (e.g., motor vehicles, power generation, and industrial facilities), residential fireplaces, and woodstoves. In addition, PM<sub>2.5</sub> can be formed in the atmosphere from gases such as sulfur oxides (SO<sub>x</sub>), NO<sub>x</sub>, and VOC. Inhalable or coarse particulate matter, or PM<sub>10</sub>, is about 1/7 the thickness of a human hair. Major sources of PM<sub>10</sub> include crushing or grinding operations; dust stirred up by vehicles traveling on roads; wood-burning stoves and fireplaces; dust from construction, landfills, and agriculture; wildfires and brush/waste burning; industrial sources; windblown dust from open lands; and atmospheric chemical and photochemical reactions.

PM<sub>2.5</sub> and PM<sub>10</sub> pose a greater health risk than larger-size particles. When inhaled, these tiny particles can penetrate the human respiratory system's natural defenses and damage the respiratory tract. PM<sub>2.5</sub> and PM<sub>10</sub> can increase the number and severity of asthma attacks, cause or aggravate bronchitis and other lung diseases, and reduce the body's ability to fight infections. Very small particles of substances, such as lead, sulfates, and nitrates, can cause lung damage directly or be absorbed into the bloodstream, causing damage elsewhere in the body. Additionally, these substances can transport absorbed gases, such as chlorides or ammonium, into the lungs, also causing injury. Whereas PM<sub>10</sub> tends to collect in the upper portion of the respiratory system, PM<sub>2.5</sub> is so tiny

that it can penetrate deeper into the lungs and damage lung tissues. Suspended particulates also damage and discolor surfaces on which they settle, as well as produce haze and reduce regional visibility.

Sulfur Dioxide (SO<sub>2</sub>). Sulfur dioxide is a colorless, pungent gas formed primarily by the combustion of sulfur containing fossil fuels. Main sources of SO<sub>2</sub> are coal and oil used in power plants and industries; as such, the highest levels of SO<sub>2</sub> are generally found near large industrial complexes. In recent years, sulfur dioxide concentrations have been reduced by the increasingly stringent controls placed on stationary source emissions of SO<sub>2</sub> and limits on the sulfur content of fuels. SO<sub>2</sub> is an irritant gas that attacks the throat and lungs and can cause acute respiratory symptoms and diminished ventilator function in children. SO<sub>2</sub> can also yellow plant leaves and corrode iron and steel.

Volatile Organic Compounds (VOC). VOCs are hydrocarbon compounds (any compound containing various combinations of hydrogen and carbon atoms) that exist in the ambient air. VOCs contribute to the formation of smog through atmospheric photochemical reactions and/or may be toxic. Compounds of carbon (also known as organic compounds) have different levels of reactivity; that is, they do not react at the same speed or do not form O<sub>3</sub> to the same extent when exposed to photochemical processes. VOCs often have an odor, and some examples include gasoline, alcohol, and the solvents used in paints. Exceptions to the VOC designation include carbon monoxide, carbon dioxide, carbonic acid, metallic carbides or carbonates, and ammonium carbonate. VOCs are a criteria pollutant since they are a precursor to O<sub>3</sub>, which is a criteria pollutant. The terms VOC and ROG (see below) are often used interchangeably.

Reactive Organic Gases (ROG). Similar to VOCs, ROGs are also precursors in forming O<sub>3</sub> and consist of compounds containing methane, ethane, propane, butane, and longer chain hydrocarbons, which are typically the result of some type of combustion/decomposition process. Smog is formed when ROG and nitrogen oxides react in the presence of sunlight. ROGs are a criteria pollutant since they are a precursor to O<sub>3</sub>, which is a criteria pollutant. The terms ROG and VOC are often used interchangeably.

### **Local Ambient Air Quality**

Ambient air quality for the Project Site can be determined from ambient air quality measurements conducted at nearby air quality monitoring stations. Existing levels of ambient air quality and historical trends in the region are documented by measurements made by the MDAQMD, the air pollution regulatory agency in the Basin that maintains air quality monitoring stations which process ambient air quality measurements. Air quality monitoring stations usually measure pollutant concentrations ten feet above ground level; therefore, air quality is often referred to in terms of ground-level concentration. The U.S. Environmental Protection Agency (USEPA) requires monitoring sites be capable of informing air pollution control officers about peak air pollution levels, typical levels in populated areas, air pollution transported into and out of a city or region, and air pollution levels near

specific sources. Monitors must be designated with an appropriate site type so that the data collected can be used to support a specific federal monitoring objective.<sup>3</sup>

## Air Quality Impacts

### Mojave Desert Air Quality Management District Thresholds

MDAQMD is the regulatory agency responsible for improving air quality for large areas for San Bernardino County's High Desert and Riverside County's Palo Verde Valley. The Project Site is located within the Mojave Desert Air Basin, which is a distinct geographic subarea within MDAQMD's jurisdiction.

The MDAQMD monitors air quality at six monitoring stations throughout the Basin.<sup>4</sup> Air quality monitoring stations usually measure pollutant concentrations ten feet above ground level; therefore, air quality is often referred to in terms of ground-level concentration. The closest air monitoring station to the Project Site that monitors CO, NO<sub>2</sub>, and O<sub>3</sub> is the Barstow Monitoring Station located approximately 39 miles northwest of the site at 301 E. Mountain View Street. The second closest air monitoring station that monitors PM<sub>2.5</sub> and PM<sub>10</sub> is the Victorville Monitoring Station, located 44 miles southeast of the site at 14306 Park Avenue. The unincorporated County land surrounding the Project Site is developed at a far lower intensity than land uses within Barstow and Victorville, meaning that the data from the Barstow and Victorville Monitoring Stations are likely substantially over predicting ambient levels at the Project Site. Nonetheless, it is the most applicable data available for all pollutants.

### Local Air Quality

The air quality data from 2020 to 2022 monitored at the Barstow and Victorville – Park Avenue Monitoring Stations is presented in **Table 1: Summary of Air Quality Data**. This table lists the monitored maximum concentrations and number of exceedances of State/Federal air quality standards for each year.

The attainment status for various pollutants in the Basin are listed in **Table 2: Federal and State Ambient Air Quality Attainment Status**. Areas that meet ambient air quality standards established by the United States Environmental Protection Agency (U.S. EPA) and/or California Air Resources Board (CARB) are classified as attainment areas, while areas that do not meet these standards are classified as nonattainment areas. Areas for which there is insufficient data available are designated unclassified. Ambient air quality standards are set to be protective of human health. As shown in **Table 2**, the Project Site is within a Federal nonattainment area for O<sub>3</sub> and PM<sub>10</sub> and a State

---

<sup>3</sup> California Air Resources Board, *Annual Network Plan, Covering Monitoring Operations in 25 California Air Districts*, <https://www.mdaqmd.ca.gov/home/showpublisheddocument/5982/636710697943470000>, accessed January 2, 2024.

<sup>4</sup> Mojave Desert Air Quality Management District (MDAQMD), Ambient Air Quality. <https://www.mdaqmd.ca.gov/air-quality/monitoring-info>, accessed January 2, 2024.

nonattainment area for O<sub>3</sub>, PM<sub>10</sub>, and PM<sub>2.5</sub>. The Project Site is classified as attainment or unclassified for lead, visibility reducing particles, sulfates, hydrogen sulfide, and vinyl chloride.

<b>Table 1: Summary of Air Quality Data</b>					
<b>Pollutant</b>	<b>California Standard</b>	<b>Federal Primary Standard</b>	<b>Year</b>	<b>Maximum Concentration<sup>1</sup></b>	<b>Days (Samples) State/Federal Std. Exceeded</b>
Ozone (O <sub>3</sub> ) (8-hour) <sup>2</sup>	0.070 ppm for 8 hours	0.070 ppm for 8 hours	2020	0.098 ppm	25/25
			2021	0.087 ppm	20 / 20
			2022	0.084 ppm	13/ 13
Ozone (O <sub>3</sub> ) (1-hour) <sup>2</sup>	0.09 ppm for 1 hour	NA <sup>6</sup>	2020	0.117 ppm	0 / 0
			2021	0.099 ppm	0 / 0
			2022	0.095 ppm	0 / 0
Carbon Monoxide (CO) (1-hour) <sup>2</sup>	20 ppm for 1 hour	35 ppm for 1 hour	2020	5.46 ppm	0 / 0
			2021	1.032 ppm	0 / 0
			2022	0.605 ppm	0 / 0
Nitrogen Dioxide (NO <sub>2</sub> ) <sup>2</sup>	0.180 ppm for 1 hour	0.100 ppm for 1 hour	2020	0.063 ppm	0 / 0
			2021	0.062 ppm	0 / 0
			2022	0.060 ppm	0 / 0
Fine Particulate Matter (PM <sub>2.5</sub> ) <sup>3</sup>	No Separate Standard	35 µg/m <sup>3</sup> for 24 hours	2020	48.4 mg/m <sup>3</sup>	4/4
			2021	87.1mg/m <sup>3</sup>	1/1
			2022	24.6mg/m <sup>3</sup>	0/0
Particulate Matter (PM <sub>10</sub> ) <sup>3</sup>	50 µg/m <sup>3</sup> for 24 hours	150 µg/m <sup>3</sup> for 24 hours <sup>7</sup>	2020	261.4 mg/m <sup>3</sup>	* <sup>8</sup> /1.9
			2021	591.6mg/m <sup>3</sup>	* <sup>8</sup> /1.0
			2022	372.1mg/m <sup>3</sup>	* <sup>8</sup> /2.1

ppm = parts per million; PM<sub>10</sub> = particulate matter 10 microns in diameter or less; mg/m<sup>3</sup> = micrograms per cubic meter; PM<sub>2.5</sub> = particulate matter 2.5 microns in diameter or less; NA = not applicable; \* = insufficient data available to determine the value

Notes:

1. Maximum concentration is measured over the same period as the California Standards.
2. Data collected from the Barstow Monitoring Station located at 301 E. Mountain View Street.
3. Data collected from the Victorville Monitoring Station located at 14306 Park Avenue.
4. PM<sub>10</sub> and PM<sub>2.5</sub> exceedances are derived from the number of days exceeded.
5. Data collected from the California Air Resources Board Air Quality Data (PST) Query Tool for the Barstow Monitoring Station.
6. The Federal standard for 1-hour ozone was revoked in June 2005.
7. The Federal standard for average PM<sub>10</sub> was revoked in December 2006.
8. \* Insufficient or no data available to determine this value

Sources:

For CO, see California Air Resources Board, *AQMIS2: Air Quality Data*, <https://www.arb.ca.gov/aqmis2/aqdselect.php>, accessed January 2, 2024.

For all other pollutants, see California Air Resources Board, *ADAM Air Quality Data Statistics*, <http://www.arb.ca.gov/adam/>, accessed January 2, 2024.

<b>Pollutant</b>	<b>Federal</b>	<b>State</b>
Ozone (O <sub>3</sub> )	Non-attainment <sup>1</sup>	Non-attainment
Nitrogen Dioxide (NO <sub>2</sub> )	Unclassified/Attainment	Attainment
Carbon Monoxide (CO)	Attainment	Attainment
Sulfur Dioxide (SO <sub>2</sub> )	Unclassified/Attainment	Attainment
Coarse Particulate Matter (PM10)	Non-attainment <sup>2</sup>	Non-attainment
Fine Particulate Matter (PM2.5)	Unclassified/Attainment	Non-attainment <sup>1</sup>
Notes:		
1. Southwest corner of desert portion of San Bernardino County only.		
2. San Bernardino County portion only.		
Source: Mojave Desert Air Quality Management District, California Environmental Quality Act (CEQA) and Federal Conformity Guidelines.		

**REGULATORY FRAMEWORK**

**Federal**

Clean Air Act

The federal Clean Air Act (CAA), which was initially established by the U.S. Congress in 1970 and substantially revised in 1977 and 1990, can be found in Title 42, Chapter 85 of the United States Code. An important aspect of the CAA is its requirement for the USEPA to establish National Ambient Air Quality Standards (NAAQS). There are NAAQS in place for seven “criteria” pollutants: CO, lead, NO<sub>2</sub>, O<sub>3</sub>, particle matter (PM10 and PM2.5), and SO<sub>2</sub>. Standards are classified as primary and secondary. Primary standards are designed to protect public health, including sensitive individuals, such as children and the elderly, whereas secondary standards are designed to protect public welfare, such as visibility and crop or material damage. The USEPA sets the NAAQS based on a process that involves science policy workshops, a risk/exposure assessment (REA) that draws on the information and conclusions of the science policy workshops to development quantitative characterizations of exposures and associated risks to human health or the environment, and a policy assessment by USEPA staff that bridges the gap between agency scientific assessments and the judgments required of the USEPA administrator, who then takes the proposed standards through the federal rulemaking process.<sup>5</sup> The NAAQS are set to be protective of human health and are listed in **Table 3: State and National Ambient Air Quality Standards**.

The CAA requires the USEPA to routinely review and update the NAAQS in accordance with the latest available scientific evidence. For example, the USEPA revoked the annual PM10 standard in 2006 due to a lack of evidence linking health problems to long-term exposure to PM10 emissions. The 1-hour

<sup>5</sup> United States Environmental Protection Agency (USEPA), Process of Reviewing the National Ambient Air Quality Standards, <https://www.epa.gov/criteria-air-pollutants/process-reviewing-national-ambient-air-quality-standards>, accessed January 2, 2024.

standard for O<sub>3</sub> was revoked in 2005 in favor of a new 8-hour standard that is intended to better protect public health.

CAA Section 182(e)(5) allows the USEPA administrator to approve provisions of an attainment strategy in an extreme area that anticipates development of new control techniques or improvement of existing control technologies if the state has submitted enforceable commitments to develop and adopt contingency measures to be implemented if the anticipated technologies do not achieve planned reductions.

Nonattainment areas are required to develop their air quality management plans to include specific emission reduction strategies to meet interim milestones in implementing emission controls and improving air quality. The USEPA can withhold certain transportation funds from states that fail to comply with the planning requirements of the act. If a state fails to correct these planning deficiencies within two years of federal notification, the USEPA is required to develop a Federal Implementation Plan for the identified nonattainment area or areas.

## State

### California Clean Air Act

The California Clean Air Act of 1988 requires all air pollution control districts in the state to aim to achieve and maintain state ambient air quality standards for O<sub>3</sub>, CO, and NO<sub>2</sub> by the earliest practical date and to develop plans and regulations specifying how the districts will meet this goal. There are no planning requirements for the State PM<sub>10</sub> standard.

CARB, which became part of the California Environmental Protection Agency in 1991, is responsible for meeting state requirements of the CAA, administering the California Clean Air Act, and establishing the California Ambient Air Quality Standards (CAAQS). The California Clean Air Act, amended in 1992, requires all air districts in the state to endeavor to achieve and maintain the CAAQS. California law does not require that CAAQS be met by specified dates as is the case with NAAQS. Rather, it requires incremental progress toward attainment.<sup>6</sup> California law continues to mandate CAAQS, although attainment of the NAAQS has precedence over attainment of the CAAQS due to federal penalties for failure to meet federal attainment deadlines.

The CAAQS are generally stricter than national standards for the same pollutants, but there is no penalty for nonattainment. Similar to the federal process, the standards for the CAAQS are adopted after review by CARB staff of the scientific literature produced by agencies such as the Office of Environmental Health Hazard Assessment (OEHHA), the Air Quality Advisory Committee, which is comprised of experts in health sciences, exposure assessment, monitoring methods, and atmospheric sciences appointed by the Office of the President of the University of California, and public review and

---

<sup>6</sup> California Air Resources Board, California Ambient Air Quality Standards, <https://ww2.arb.ca.gov/resources/california-ambient-air-quality-standards>, accessed January 2, 2024.

comment.<sup>7</sup> The CAAQS are set at levels determined to be protective of human health. State and national standards are listed in **Table 3**.

<b>Table 3: State and National Ambient Air Quality Standards</b>			
<b>Pollutant</b>	<b>Averaging Time</b>	<b>State Standards<sup>1</sup></b>	<b>Federal Standards<sup>2</sup></b>
Ozone (O <sub>3</sub> ) <sup>2,5,7</sup>	8 Hour	0.070 ppm (137 µg/m <sup>3</sup> )	0.070 ppm
	1 Hour	0.09 ppm (180 µg/m <sup>3</sup> )	0.12 ppm
Carbon Monoxide (CO)	8 Hour	9.0 ppm (10 mg/m <sup>3</sup> )	9 ppm (10 mg/m <sup>3</sup> )
	1 Hour	20 ppm (23 mg/m <sup>3</sup> )	35 ppm (40 mg/m <sup>3</sup> )
Nitrogen Dioxide (NO <sub>2</sub> )	1 Hour	0.18 ppm (339 µg/m <sup>3</sup> )	0.10 ppm <sup>11</sup>
	Annual Arithmetic Mean	0.030 ppm (57 µg/m <sup>3</sup> )	0.053 ppm (100 µg/m <sup>3</sup> )
Sulfur Dioxide (SO <sub>2</sub> ) <sup>8</sup>	24 Hour	0.04 ppm (105 µg/m <sup>3</sup> )	NA
	1 Hour	0.25 ppm (655 µg/m <sup>3</sup> )	0.075 ppm (196 µg/m <sup>3</sup> )
Particulate Matter (PM <sub>10</sub> ) <sup>1,3,6</sup>	24-Hour	50 µg/m <sup>3</sup>	150 µg/m <sup>3</sup>
	Annual Arithmetic Mean	20 µg/m <sup>3</sup>	NA
Fine Particulate Matter (PM <sub>2.5</sub> ) <sup>3,4,6,9</sup>	24-Hour	NA	35 µg/m <sup>3</sup>
	Annual Arithmetic Mean	12 µg/m <sup>3</sup>	9 µg/m <sup>3</sup>
Sulfates (SO <sub>4-2</sub> )	24 Hour	25 µg/m <sup>3</sup>	NA
Lead (Pb) <sup>10,11</sup>	30-Day Average	1.5 µg/m <sup>3</sup>	0.15 µg/m <sup>3</sup>
Hydrogen Sulfide (H <sub>2</sub> S)	1 Hour	0.03 ppm (0.42 µg/m <sup>3</sup> )	NA
Vinyl Chloride (C <sub>2</sub> H <sub>3</sub> Cl) <sup>10</sup>	24 Hour	0.01 ppm (26 µg/m <sup>3</sup> )	NA
<p>Notes:</p> <p>ppm = parts per million; µg/m<sup>3</sup> = micrograms per cubic meter; mg/m<sup>3</sup> = milligrams per cubic meter; NA = no information available.</p> <ol style="list-style-type: none"> <li>California standards for O<sub>3</sub>, carbon monoxide (except Lake Tahoe), sulfur dioxide (1-hour and 24-hour), nitrogen dioxide, suspended particulate matter - PM<sub>10</sub>, and visibility reducing particles are values that are not to be exceeded. The standards for sulfates, Lake Tahoe carbon monoxide, lead, hydrogen sulfide, and vinyl chloride are not to be equaled or exceeded. If the standard is for a 1-hour, 8-hour or 24-hour average (i.e. all standards except for lead and the PM<sub>10</sub> annual standard), then some measurements may be excluded. Measurements are excluded that CARB determines would occur less than once per year on the average. The Lake Tahoe carbon monoxide standard is 6.0 ppm, a level one-half the national standard and two-thirds the State standard.</li> <li>National standards shown are the "primary standards" designed to protect public health. National standards other than for O<sub>3</sub>, particulates and those based on annual averages are not to be exceeded more than once a year. The 1-hour O<sub>3</sub> standard is attained if, during the most recent three-year period, the average number of days per year with maximum hourly concentrations above the standard is equal to or less than one. The 8-hour O<sub>3</sub> standard is attained when the 3-year average of the 4<sup>th</sup> highest daily concentrations is 0.070 ppm or less. The 24-hour PM<sub>10</sub> standard is attained when the 3-year average of the 99<sup>th</sup> percentile of monitored concentrations is less than 150 µg/m<sup>3</sup>. The 24-hour PM<sub>2.5</sub> standard is attained when the 3-year average of 98<sup>th</sup> percentiles is less than 35 µg/m<sup>3</sup>.</li> <li>Except for the national particulate standards, annual standards are met if the annual average falls below the standard at every site. The national annual particulate standard for PM<sub>10</sub> is met if the 3-year average falls below the standard at every site. The annual PM<sub>2.5</sub> standard is met if the 3-year average of annual averages spatially-averaged across</li> </ol>			

<sup>7</sup> California Air Resources Board, California Ambient Air Quality Standards.

Table 3: State and National Ambient Air Quality Standards			
Pollutant	Averaging Time	State Standards <sup>1</sup>	Federal Standards <sup>2</sup>
officially designed clusters of sites falls below the standard.			
4. On October 1, 2015, the national 8-hour O <sub>3</sub> primary and secondary standards were lowered from 0.075 to 0.070 ppm. An area will meet the standard if the fourth-highest maximum daily 8-hour O <sub>3</sub> concentration per year, averaged over three years, is equal to or less than 0.070 ppm. U.S. EPA will make recommendations on attainment designations by October 1, 2016, and issue final designations October 1, 2017. Nonattainment areas will have until 2020 to late 2037 to meet the health standard, with attainment dates varying based on the O <sub>3</sub> level in the area.			
5. The national 1-hour O <sub>3</sub> standard was revoked by the U.S. EPA on June 15, 2005.			
6. In June 2002, CARB established new annual standards for PM <sub>2.5</sub> and PM <sub>10</sub> .			
7. The 8-hour California O <sub>3</sub> standard was approved by the CARB on April 28, 2005 and became effective on May 17, 2006.			
8. On June 2, 2010, the U.S. EPA established a new 1-hour SO <sub>2</sub> standard, effective August 23, 2010, which is based on the 3-year average of the annual 99 <sup>th</sup> percentile of 1-hour daily maximum concentrations. The existing 0.030 ppm annual and 0.14 ppm 24-hour SO <sub>2</sub> NAAQS however must continue to be used until one year following U.S. EPA initial designations of the new 1-hour SO <sub>2</sub> NAAQS.			
9. In February 2024, U.S. EPA strengthened the annual PM <sub>2.5</sub> NAAQS from 12.0 to 9.0 µg/m <sup>3</sup> . Areas designated “unclassifiable/attainment” must continue to take steps to prevent their air quality from deteriorating to unhealthy levels. The effective date of this standard is May 6, 2024.			
10. CARB has identified lead and vinyl chloride as ‘toxic air contaminants’ with no threshold level of exposure below which there are no adverse health effects determined.			
11. National lead standard, rolling 3-month average: final rule signed October 15, 2008. Final designations effective December 31, 2011.			
Source: South Coast Air Quality Management District, <i>Air Quality Management Plan</i> , 2022. <a href="https://www.aqmd.gov/docs/default-source/clean-air-plans/air-quality-management-plans/2022-air-quality-management-plan/final-2022-aqmp/05-ch2.pdf?sfvrsn=12">https://www.aqmd.gov/docs/default-source/clean-air-plans/air-quality-management-plans/2022-air-quality-management-plan/final-2022-aqmp/05-ch2.pdf?sfvrsn=12</a>			

State Implementation Plans

An important component of the MDAQMD’s air quality planning strategy is contained in the State Implementation Plan (SIP) for the State of California. The CAA requires all states to submit a SIP to the USEPA. This statewide SIP is often referred to as an “infrastructure” SIP. Infrastructure SIPs are administrative in nature and describe the authorities, resources, and programs a state has in place to implement, maintain, and enforce the federal standards. It does not contain any proposals for emission control measures.

In addition to infrastructure SIPs, the Clean Air Act requires submissions of SIPs for areas that are out of compliance with the NAAQS. These area attainment SIPs are comprehensive plans that describe how an out-of-compliance area will attain and maintain the particular NAAQS standard(s) it does not conform to. Once an out-of-compliance area has attained the standard in question, a maintenance SIP is required for a period of time to ensure the area will continue to meet the standard.

SIPs are not single documents. They are a compilation of new and previously submitted plans, programs (such as monitoring, modeling, permitting, etc.), district rules, State regulations, and federal controls. Many of California’s SIPs rely on the same core set of control strategies, including emission standards for cars and heavy trucks, fuel regulations, and limits on emissions from consumer products. State law makes CARB the lead agency for all purposes related to SIPs. Local air districts and other



agencies prepare SIP elements and submit them to CARB for review and approval. CARB forwards those revisions to the USEPA for approval and publication in the Federal Register.

## Local

### Mojave Desert Air Quality Management District (MDAQMD)

#### *MDAQMD Federal 8-hour Ozone Attainment Plan (Western Mojave Desert Non-Attainment Area)*

On April 15, 2004, the USEPA designated the Western Mojave Desert nonattainment area as nonattainment of the O<sub>3</sub> NAAQS pursuant to the provisions of the Federal CAA. The Western Mojave Desert Ozone Nonattainment Area includes part of San Bernardino County, a portion of the MDAQMD, as well as the Antelope Valley portion of Los Angeles County. As a result, the MDAQMD prepared its Ozone Attainment Plan in June 2008 to: (1) demonstrate that the MDAQMD will meet the primary required Federal O<sub>3</sub> planning milestones, attainment of the 8-hour O<sub>3</sub> NAAQS by 2033 (Plan revised January 2023); (2) present the progress the MDAQMD will make towards meeting all required ozone planning milestones; and (3) discuss the newest 0.075 part per million 8-hour ozone NAAQS, preparatory to an expected non-attainment designation for the new NAAQS. In February 2017, MDAQMD updated the 2008 Ozone Attainment Plan and adopted the *MDAQMD Federal 75 ppb Ozone Attainment Plan (Western Mojave Desert Nonattainment Plan)* to satisfy CAA requirements that the MDAQMD develop a plan to attain the 0.075 ppm 8-hour ozone NAAQS.

#### *Final Mojave Desert Planning Area Federal Particulate Matter 10 (PM10) Attainment Plan*

On January 20, 1994, the USEPA re-designated a significant portion of the Mojave Desert as a nonattainment area with respect to the PM<sub>10</sub> NAAQS. This nonattainment area covers a vast geographical region, including the urban areas of Victor Valley and Barstow, the Morongo Basin, along with the rural desert environs reaching to the Nevada and Arizona state lines. The PM<sub>10</sub> Attainment Plan was prepared in July 1995 to provide a complete description and submittal to USEPA of the PM<sub>10</sub> attainment planning elements which the MDAQMD will implement to bring the nonattainment area into compliance with federal law. Most importantly, the PM<sub>10</sub> Attainment Plan serves as a planning tool for reducing PM<sub>10</sub> pollution. The PM<sub>10</sub> Attainment Plan sets forth an air quality improvement program for the region which will be implemented by both the public and private sector of the community.

#### *MDAQMD Rules*

The MDAQMD has adopted rules to limit air emissions. Many of these rules were put in place as required by measures specified in various SIPs and air quality management plans. The MDAQMD rules that are applicable to the Project include, but are not limited to, those listed below:

- Rule 201 – Written Authorization. This rule prohibits the building, erection, installation, alteration, or replacement of any equipment that may affect the issuance of air contaminants

without first obtaining written authorization for such construction from the Air Pollution Control Officer.

- Rule 203 – Permit to Operate. This rule prohibits the operation of equipment that may affect the issuance of air contaminants without first obtaining a written permit from the Air Pollution Control Officer.
- Rule 206 – Posting of Permit to Operate. Permits and written authorizations granted under Rule 201 and/or 203 must be posted to be completely visible on the equipment Rule 401 – Visible Emissions. This rule prohibits discharges of air contaminants or other material, which are as dark or darker in shade as that designated No. 1 on the Ringelmann Chart.
- Rule 402 – Nuisance. This rule prohibits the discharge of air contaminants or other material that cause injury, detriment, nuisance, or annoyance to any considerable number of persons or to the public.
- Rule 403 – Fugitive Dust. The purpose of this rule is to control the amount of PM entrained in the atmosphere from manmade sources of fugitive dust. The rule prohibits emissions of fugitive dust from any active operation, open storage pile, or disturbed surface area to be visible beyond the emission source’s property line.
- Rule 404 – Particulate Matter Concentration. Prohibits discharge from any source of particulate matter in excess of the concentration at standard conditions, shown in Table 404(a) of Appendix B.
- Rule 409 – Combustion Contaminants. Prohibits the burning of fuel that results in the discharge of contaminants exceeding 0.23 grams per cubic meter (0.1 grain per cubic foot) of gas calculated to 12 percent of carbon dioxide (CO<sub>2</sub>) at standard conditions averaged over a minimum of 15 consecutive minutes.
- Rule 431 – Sulfur Content in Fuels. Limits the sulfur content in fuels during combustion in stationary equipment.
- Rule 474 – Fuel Burning Equipment. Limits the emissions of oxides of nitrogen (NO<sub>x</sub>) from non-Mobile, Fuel Burning Equipment.

### San Bernardino County General Plan

The County’s Countywide Plan, adopted on October 27, 2020, serves as a set of plans and tools for the County’s unincorporated communities and complements the Countywide vision. The Countywide Plan consists of the Policy Plan, Business Plan, and Community Action Guides, together with the supporting environmental clearance. The Policy Plan is a component of the Countywide Plan that is an update and expansion of the County’s General Plan for the unincorporated areas. The following goals and policies are applicable to the Project:

#### *Natural Resources Element*

##### Goal NR-1: Air Quality

Air quality that promotes health and wellness of residents in San Bernardino County through improvements in locally generated emission.

- Policy NR-1.1 Land use. We promote compact and transit-oriented development countywide and regulate the types and locations of development in unincorporated areas to minimize vehicle miles traveled and greenhouse gas emissions.
- Policy NR-1.2 Indoor air quality. We promote the improvement of indoor air quality through the California Building and Energy Codes and through the provision of public health programs and services.
- Policy NR-1.3 Coordination on air pollution. We collaborate with air quality management districts and other local agencies to monitor and reduce major pollutants affecting the county at the emission source.
- Policy NR-1.6 Fugitive dust emissions. We coordinate with air quality management districts on requirements for dust control plans, revegetation, and soil compaction to prevent fugitive dust emissions.
- Policy NR-1.8 Construction and operations. We invest in County facilities and fleet vehicles to improve energy efficiency and reduce emissions. We encourage County contractors and other builders and developers to use low-emission construction vehicles and equipment to improve air quality and reduce emissions.
- Policy NR-1.9 Building design and upgrades. We use the CALGreen Code to meet energy efficiency standards for new buildings and encourage the upgrading of existing buildings to incorporate design elements, building materials, and fixtures that improve environmental sustainability and reduce emissions.

*Renewable Energy Element*

- RE Policy 4.1 Apply standards to the design, siting, and operation of all renewable energy facilities that protect the environment, including sensitive biological resources, air quality, water supply and quality, cultural, archaeological, paleontological and scenic resources.
- RE Policy 4.3.1 Define measures required to minimize ground disturbance, soil erosion, flooding, and blowing of sand and dust, with appropriate enforcements mechanisms in the Development Code.

*Hazards Element*

- Policy HZ-3.3 Air quality management districts establish community emissions reduction plans for unincorporated environmental justice focus areas that should be considered in these areas. With particular emphasis in addressing the types of pollution identified in the Hazard Element table.

San Bernardino County Development Code of Ordinances

The San Bernardino County Development Code of Ordinances Section 83.01.040 *Air Quality* will apply to the construction phase of the Project. Relevant provisions of the section are listed below.

- (c) Diesel Exhaust Emissions Control Measures. The following emissions control measures shall apply to all discretionary land use projects approved by the County on or after January 15, 2009:
- (1) On-Road Diesel Vehicles. On-road diesel vehicles are regulated by the State of California Air Resources Board.
  - (2) Off-Road Diesel Vehicle/Equipment Operations. All business establishments and contractors that use off-road diesel vehicle/equipment as part of their normal business operations shall adhere to the following measures during their operations in order to reduce diesel particulate matter emissions from diesel-fueled engines:
    - (A) Off-road vehicles/equipment shall not be left idling on site for periods in excess of five minutes. The idling limit does not apply to:
      - (I) Idling when queuing;
      - (II) Idling to verify that the vehicle is in safe operating condition;
      - (III) Idling for testing, servicing, repairing or diagnostic purposes;
      - (IV) Idling necessary to accomplish work for which the vehicle was designed (such as operating a crane);
      - (V) Idling required to bring the machine system to operating temperature; and
      - (VI) Idling necessary to ensure safe operation of the vehicle.
    - (B) Use reformulated ultra-low-sulfur diesel fuel in equipment and use equipment certified by the U.S. Environmental Protection Agency (EPA) or that pre-dates EPA regulations.
    - (C) Maintain engines in good working order to reduce emissions.
    - (D) Signs shall be posted requiring vehicle drivers to turn off engines when parked.
    - (E) Any requirements or standards subsequently adopted by the South Coast Air Quality Management District, the Mojave Desert Air Quality Management District or the California Air Resources Board.
    - (F) Provide temporary traffic control during all phases of construction.
    - (G) On-site electrical power connections shall be provided for electric construction tools to eliminate the need for diesel-powered electric generators, where feasible.
    - (H) Maintain construction equipment engines in good working order to reduce emissions. The developer shall have each contractor certify that all construction equipment is properly serviced and maintained in good operating condition.
    - (I) Contractors shall use ultra-low sulfur diesel fuel for stationary construction equipment as required by Air Quality Management District (AQMD) Rules 431.1 and 431.2 to reduce the release of undesirable emissions.
    - (J) Substitute electric and gasoline-powered equipment for diesel-powered equipment, where feasible.

San Bernardino County Code of Ordinances Section 84.29.035 *Required Findings for Approval of a Commercial Solar Energy Facility* includes the following requirements relevant to fugitive dust emissions:

- (c) The finding of fact shall include the following:
  - (20) The proposed commercial solar energy generation facility will be designed, constructed, and operated so as to minimize dust generation, including provision of sufficient watering of excavated or graded soil during construction to prevent excessive dust. Watering will occur at a minimum of three (3) times daily on disturbed soil areas with active operations, unless dust is otherwise controlled by rainfall or use of a dust palliative, or other approved dust control measure.
  - (21) All clearing, grading, earth moving, and excavation activities will cease during period of winds greater than 20 miles per hour (mph), averaged over one hour, or when dust plumes of 20 percent or greater opacity impact public roads, occupied structures, or neighboring property, and in conformance with AQMD regulations.
  - (22) For sites where the boundary of a new commercial solar energy generation facility will be located within one-quarter mile of a primary residential structure, an adequate wind barrier will be provided to reduce potentially blowing dust in the direction of the residence during construction and ongoing operation of the commercial solar energy generation facility.
  - (23) Any unpaved roads and access ways will be treated and maintained with a dust palliative or graveled or treated by another approved dust control Chapter 83.09 of the Development Code.
  - (24) On-site vehicle speed will be limited to 15 mph.

**CALIFORNIA ENVIRONMENTAL QUALITY ACT (CEQA) THRESHOLDS OF SIGNIFICANCE**

In accordance with Appendix G of the California Environmental Quality Act (CEQA) Guidelines, the Project would have a significant impact in regard to air quality if one or more of the following would occur:

- Threshold a): Conflict with or obstruct implementation of the applicable air quality plan (refer to Impact AQ-1);**
- Threshold b): Result in a cumulatively considerable net increase of any criteria pollutant for which the project region is in nonattainment under an applicable Federal or State ambient air quality standard (refer to Impact AQ-2);**
- Threshold c): Expose sensitive receptors to substantial pollutant concentrations (refer to Impact AQ-3); or**
- Threshold d): Result in other emissions (such as those leading to odors) adversely affecting a substantial number of people (refer to Impact AQ-4).**

**MDAQMD Air Quality Thresholds**

Under CEQA, the MDAQMD is an expert commenting agency on air quality and related matters within its jurisdiction or impacting on its jurisdiction. Under the CAA, the MDAQMD has adopted federal attainment plans for O<sub>3</sub> and PM<sub>10</sub>. The MDAQMD has dedicated assets to reviewing projects to ensure that they will not: (1) cause or contribute to any new violation of any air quality standard; (2) increase the frequency or severity of any existing violation of any air quality standard; or (3) delay timely attainment of any air quality standard or any required interim emission reductions or other milestones of any federal attainment plan.

According to the MDAQMD’s *CEQA and Federal Conformity Guideline*, a project is significant if it triggers or exceeds the most appropriate evaluation criteria:

1. Generates total emissions (direct and indirect) in the excess of the thresholds given in **Table 4: MDAQMD Significant Emissions Threshold;**
2. Generates a violation of any ambient air quality standard when added to the local background;
3. Does not conform with the applicable attainment or maintenance plan(s)<sup>8</sup>;
4. Exposes sensitive receptors to substantial pollution concentrations, including those resulting in a cancer risk greater than or equal to 10 in a million and/ or a Hazard Index (HI) (non-cancerous) greater than or equal to 1.

<b>Table 4: MDAQMD Significant Emissions Thresholds</b>		
<b>Criteria Pollutant</b>	<b>Annual Threshold (tons)</b>	<b>Daily Threshold (pounds)</b>
Carbon Monoxide (CO)	100	548
Oxides of Nitrogen (NO <sub>x</sub> )	25	137
Volatile Organic Compounds (VOC)	25	137
Oxides of Sulfur (SO <sub>x</sub> )	25	137
Particulate Matter (PM <sub>10</sub> )	15	82
Fine Particulate Matter (PM <sub>2.5</sub> )	12	65
Hydrogen Sulfide (H <sub>2</sub> S)	10	54
Lead (Pb)	0.6	3

Source: Mojave Desert Air Quality Management District, CEQA and Federal Conformity Guidelines, page 9, February 2020.

<sup>8</sup> A project is deemed to not exceed this threshold, and hence not be significant, if it is consistent with the existing land use plan. Zoning changes, specific plans, general plan amendments and similar land use plan changes which do not increase dwelling unit density, do not increase vehicle trips, and do not increase vehicle miles traveled are also deemed to not exceed this threshold.

**IMPACT ANALYSIS****Impact AQ-1: Would the Project conflict with or obstruct implementation of the applicable air quality plan?**

The Project Site is located within the Mojave Desert Air Basin and is regulated by the MDAQMD. The MDAQMD PM10 Attainment Plan and Ozone Attainment Plan established under the Western Mojave Desert Air Quality Management Plans (AQMPs) set forth a comprehensive set of programs that will lead the Mojave Desert Air Basin into compliance with federal and State air quality standards. The control measures and related emission reduction estimates within the MDAQMD PM10 Attainment Plan and Ozone Attainment Plan are based upon emissions projections for a future development scenario derived from land use, population, and employment characteristics defined in consultation with local governments. Accordingly, conformance with these attainment plans is determined by:

- Demonstrating Project consistency with local land use plans and/or population projections (**Criterion 1**);
- Demonstrating Project compliance with applicable MDAQMD Rules and Regulations (**Criterion 2**); and
- Demonstrating Project implementation will not increase the frequency or severity of a violation in the Federal or State ambient air quality standards (**Criterion 3**).

**Criterion 1:** Consistency with local land use plans and/or population projections.

Growth projections included in the AQMPs form the basis for the projections of air pollutant emissions and are based on general plan land use designations and the Southern California Association of Governments (SCAG) 2016–2040 Regional Transportation Plan/Sustainable Communities Strategy (RTP/SCS) demographics forecasts. While SCAG has recently adopted the 2020-2045 RTP/SCS, the MDAQMD has not released an updated AQMP that utilizes information from the 2020-2045 RTP/SCS. As such, this consistency analysis is based off the 2016-2040 RTP/SCS. The population, housing, and employment forecasts within the 2016-2040 RTP/SCS are based on local general plans as well as input from local governments, such as the County. The MDAQMD has incorporated these same demographic growth forecasts for various socioeconomic categories (e.g., population, housing, employment) into the AQMPs.

Zoning is local law that regulates various aspects of how land can be used. Zoning in the Project area is regulated by the San Bernardino County Development Code and Zoning designations that are found in the Countywide Plan/Policy Plan.<sup>9</sup> The Project Site is designated as RLM (Resource Land Management) in the Countywide Plan/Policy Plan. The existing zoning for the Project is also RC

---

<sup>9</sup> San Bernardino County Land Use Service Zoning Maps, Interactive Zoning Layer, <https://lus.sbcounty.gov/planning-home/zoning-and-overlay-maps/zoning-maps/>, accessed on January 2, 2024.

(Resource Conservation). Pursuant to San Bernardino County Development Code Section 82.04.040, renewable energy generation facilities is a permitted use with an approved CUP.

The County's area population estimate as of January 1, 2023 was 297,482 persons, and the County's total area population estimate as of January 1, 2023 was 2,182,056.<sup>10</sup> SCAG growth forecasts in the 2016-2040 RTP/SCS estimate the County's unincorporated population to reach 344,100 persons by 2040, representing a total increase of 48,500 persons between 2012 and 2040. Additionally, SCAG growth forecasts in the 2016-2040 RTP/SCS estimate the unincorporated County's employment to reach 91,100 jobs by 2040, representing a total increase of 33,700 jobs between 2012 and 2040.<sup>11</sup>

The Project would include neither a residential component that would increase local population growth, nor a commercial component that would substantially increase employment. Construction of the Project would not result in residential, commercial, or growth-inducing development that would result in a substantial increase in growth-related emissions. In addition, because of the presence of locally available construction workers, and because of the relatively short duration of construction (approximately nine months), workers are not expected to relocate to the area with their families.

The Project would operate year-round. Typical O&M activities during Project operations include, but are not limited to, facility monitoring; administration and reporting; remote operations of inverters, BESS system, and other equipment; repair and maintenance of solar facilities, electrical transmission lines, and other Project facilities; and periodic panel washing. Therefore, limited staff would be required during operations. As such, there would be no employee or population growth as a result of the Project, and the Project would not cause the SCAG growth forecast to be exceeded. As the MDAQMD has incorporated these forecasts on population, housing, and employment into the AQMPs, the Project would be consistent with the AQMPs. The Project would be consistent with this criterion.

**Criterion 2:** Compliance with applicable MDAQMD Rules and Regulations.

The Project would be required to comply with all applicable MDAQMD Rules and Regulations. This would include MDAQMD Rules 401, 402, and 403. MDAQMD Rule 403 requires periodic watering for short-term stabilization of disturbed surface area to minimize visible fugitive dust (PM10) emissions, covering loaded haul vehicles, and reduction of non-essential earth moving activities during higher wind conditions. The Project would comply with applicable MDAQMD rules, enforced through Project Conditions of Approval, and not conflict with applicable MDAQMD Rules and Regulations. Therefore, the Project would be consistent with this criterion.

---

<sup>10</sup> State of California Department of Finance, E-5 Population and Housing Estimates for Cities, Counties, and the State, January 2021-2022, with 2020 Benchmark, May 2022.

<sup>11</sup> Southern California Association of Governments, 2016-2040 Regional Transportation Plan/Sustainable Communities Strategy, Demographics & Growth Forecast Appendix, April 2016.



**Criterion 3:** Demonstrating Project implementation will not increase the frequency or severity of a violation in the Federal or State ambient air quality standards.

Analysis of the Project's potential to result in more frequent or severe violations of the CAAQS and NAAQS can be satisfied by comparing Project emissions to MDAQMD thresholds. As discussed under Impact AQ-2 below, unmitigated short-term construction emissions would not exceed MDAQMD significance thresholds. Additionally, unmitigated long-term operational emissions of all criteria pollutants studied (NO<sub>x</sub>, ROG, CO, sulfur dioxide [SO<sub>2</sub>], PM10, and PM2.5) would be less than the applicable MDAQMD significance thresholds. Therefore, the Project would not delay the Mojave Desert Air Basin's attainment goals for O<sub>3</sub><sup>12</sup>, PM10, and PM2.5, and would not result in an increase in the frequency or severity of existing air quality violations. As such, the Project would not cause or contribute to localized air quality violations or delay the attainment of air quality standard or interim emissions reductions specified in the AQMPs. Thus, the Project would be consistent with this criterion.

### Conclusion

As discussed above, the Project would comply with MDAQMD Rules and Regulations and would not induce residential or worker population growth. Further, the Project would not cause or contribute to localized air quality violations or delay the attainment of air quality standard or interim emissions reductions specified in the AQMPs. Thus, the Project would not result in or cause NAAQS or CAAQS violations. The Project would meet Criterion 1, Criterion 2, and Criterion 3. As such, the Project would be consistent with the MDAQMD's AQMPs and impacts would be less than significant.

**Impact Determination:** Less Than Significant Impact.

**Mitigation Measures:** No mitigation is required.

**Impact AQ-2: Would the Project result in a cumulatively considerable net increase of any criteria pollutant for which the Project region is non-attainment under an applicable Federal or State ambient air quality standard?**

### Construction

Project construction involving the use of heavy-duty construction equipment is anticipated to be completed over a period of approximately nine months.<sup>13</sup> The Project involves construction activities associated with demolition, site preparation, grading, construction/installation, PV vendor trips, and paving.

---

<sup>12</sup> Ground level O<sub>3</sub> is created during a photochemical reaction from NO<sub>x</sub> and ROG emissions.

<sup>13</sup> Note that the modeling does not account for testing, commissioning, and cleanup as heavy-duty construction equipment would not be utilized.

### Exhaust Emissions

Exhaust emissions (e.g., ROG, NO<sub>x</sub>, and CO) from Project construction activities would include emissions associated with the transport of machinery and supplies/materials to and from the Project Site, emissions produced on-site as the equipment is used, and emissions from construction workers' personal vehicles traveling to/from the site. Mobile source criteria pollutant emissions are based on the actual number of worker trips and delivery truck trips associated with construction of the proposed Project.

Exhaust emission factors for typical diesel-powered heavy equipment are based on the California Emissions Estimator Model version 2022.1 (CalEEMod) program defaults. Variables factored into estimating the total construction emissions include the level of activity, length of construction period, number of pieces and types of equipment in use, site characteristics, weather conditions, number of construction personnel, and the amount of materials to be transported on- or off-site. The analysis includes emissions from delivering the construction materials and PV modules (panels) from the nearest port (one-way distance of approximately 136 miles). Additionally, construction worker trip emissions are based on the maximum construction workforce (70 individuals) and the distance to the nearest populated areas (California City and Lancaster; an average one-way distance of 48 miles). Further, as water would be trucked in from an off-site source a construction water truck trip length of 48 miles was accounted for in CalEEMod.

### Fugitive Dust Emissions

Fugitive dust from site preparation and facilities construction activities is expected to be short-term and would cease upon completion of Project construction. The Project would implement all applicable MDAQMD dust control techniques, limitations on construction hours, and adhere to the MDAQMD Rule 403 (which requires watering of inactive and perimeter areas, track out requirements, etc.) to reduce PM<sub>10</sub> and PM<sub>2.5</sub> concentrations. Additionally, the Project would comply with the San Bernardino County Code of Ordinances Section 84.29.035, which would further reduce emissions from certain pollutants related to construction exhaust.

### Total Construction Emissions

The analysis of daily construction emissions has been prepared using CalEEMod and the RCEM. Refer to **Appendix A: Air Quality Emissions Data**, for the CalEEMod outputs and results. **Table 5: Daily Construction Emissions** and **Table 6: Annual Construction Emissions** present the anticipated short-term construction emissions. As indicated in **Table 5** and **Table 6**, criteria pollutant emissions during Project construction would not exceed the MDAQMD significance thresholds. Therefore, total Project construction-related air emissions would be less than significant.

**Table 5: Daily Construction Emissions**

Construction Year	Maximum Pounds per Day <sup>1,2</sup>					
	ROG	NO <sub>x</sub>	CO	SO <sub>2</sub>	PM10	PM2.5
Year (2025)	7.24	69.27	73.62	0.19	5.87	4.52
Year (2026)	3.29	26.87	37.49	0.07	9.73	4.45
<b>MDAQMD Thresholds</b>	<b>137</b>	<b>137</b>	<b>548</b>	<b>137</b>	<b>82</b>	<b>65</b>
<b>Exceed MDAQMD Threshold?</b>	<b>No</b>	<b>No</b>	<b>No</b>	<b>No</b>	<b>No</b>	<b>No</b>

ROG = Reactive Organic Gases; NO<sub>x</sub> = Nitrogen Oxides; CO = Carbon Monoxide; SO<sub>2</sub> = Sulfur Dioxide; PM10 = Particulate Matter 10 microns in diameter or less; PM2.5 = Particulate Matter 2.5 microns in diameter or less

Notes:

- The highest values between summer and winter results were used as a worst-case scenario.
- The reductions/credits for construction emissions are based on adjustments to CalEEMod and are required by the MDAQMD Rules. The adjustments applied in CalEEMod includes the following: properly maintain mobile and other construction equipment; replace ground cover in disturbed areas quickly; water exposed surfaces three times daily; cover stockpiles with tarps; and limit speeds on unpaved roads to 15 miles per hour.

Source: CalEEMod version 2022.1 and RCEM Version 9.0.0. Refer to **Appendix A** for model outputs.

**Table 6: Annual Construction Emissions**

Construction Year	Maximum Tons per Year <sup>1</sup>					
	ROG	NO <sub>x</sub>	CO	SO <sub>2</sub>	PM10	PM2.5
Year (2025)	0.09	0.72	0.97	<0.01	0.24	0.10
Year (2026)	0.09	0.76	1.07	<0.01	0.02	0.01
<b>MDAQMD Thresholds</b>	<b>25</b>	<b>25</b>	<b>100</b>	<b>25</b>	<b>15</b>	<b>12</b>
<b>Exceed MDAQMD Threshold?</b>	<b>No</b>	<b>No</b>	<b>No</b>	<b>No</b>	<b>No</b>	<b>No</b>

ROG = Reactive Organic Gases; NO<sub>x</sub> = Nitrogen Oxides; CO = Carbon Monoxide; SO<sub>2</sub> = Sulfur Dioxide; PM10 = Particulate Matter 10 microns in diameter or less; PM2.5 = Particulate Matter 2.5 microns in diameter or less

Notes:

- The reductions/credits for construction emissions are based on adjustments to CalEEMod and are required by the MDAQMD Rules. The adjustments applied in CalEEMod includes the following: properly maintain mobile and other construction equipment; replace ground cover in disturbed areas quickly; water exposed surfaces three times daily; cover stockpiles with tarps; and limit speeds on unpaved roads to 15 miles per hour.

Source: CalEEMod version 2022.1 and RCEM Version 9.0.0. Refer to **Appendix A** for model outputs.

**Operations**

Operational emissions associated with the Project would include those generated from panel washing, maintenance, and the BESS. **Table 7: Daily Operational Emissions** and **Table 8: Annual Operational Emissions** present the Project’s anticipated mobile source (i.e., motor vehicle use), energy source, and area source emissions. Each of these sources are described below.

<b>Table 7: Daily Operational Emissions</b>						
Source	Maximum Pounds Per Day <sup>1</sup>					
	ROG	NO <sub>x</sub>	CO	SO <sub>2</sub>	PM10	PM2.5
Area	76.6	0.94	111.77	0.01	0.20	0.15
Energy	0.00	0.00	0.00	0.00	0.00	0.00
Mobile	0.01	0.36	0.06	<0.01	0.10	0.03
<i>Total Emissions</i>	<i>76.62</i>	<i>1.30</i>	<i>111.82</i>	<i>0.01</i>	<i>0.30</i>	<i>0.18</i>
<b>MDAQMD Thresholds</b>	<b>137</b>	<b>137</b>	<b>548</b>	<b>137</b>	<b>82</b>	<b>65</b>
<b>Exceed MDAQMD Threshold?</b>	<b>No</b>	<b>No</b>	<b>No</b>	<b>No</b>	<b>No</b>	<b>No</b>
ROG = Reactive Organic Gases; NO <sub>x</sub> = Nitrogen Oxides; CO = Carbon Monoxide; SO <sub>2</sub> = Sulfur Dioxide; PM10 = Particulate Matter 10 microns in diameter or less; PM2.5 = Particulate Matter 2.5 microns in diameter or less Note: Total values are from CalEEMod and may not add up 100 percent due to rounding. 1. The highest values between summer and winter results were used as a worst-case scenario. Source: CalEEMod version 2022.1. See to <b>Appendix A</b> for model outputs.						

<b>Table 8: Annual Operational Emissions</b>						
Source	Maximum Tons per Year					
	ROG	NO <sub>x</sub>	CO	SO <sub>2</sub>	PM10	PM2.5
Area	12.28	0.08	10.06	<0.01	0.02	0.01
Energy	0.00	0.00	0.00	0.00	0.00	0.00
Mobile	<0.01	0.05	0.01	<0.01	0.01	<0.01
<i>Total Emissions<sup>1</sup></i>	<i>12.3</i>	<i>0.13</i>	<i>10.1</i>	<i>&lt;0.01</i>	<i>0.03</i>	<i>0.02</i>
<b>MDAQMD Thresholds</b>	<b>25</b>	<b>25</b>	<b>100</b>	<b>25</b>	<b>15</b>	<b>12</b>
<b>Exceed MDAQMD Threshold?</b>	<b>No</b>	<b>No</b>	<b>No</b>	<b>No</b>	<b>No</b>	<b>No</b>
ROG = Reactive Organic Gases; NO <sub>x</sub> = Nitrogen Oxides; CO = Carbon Monoxide; SO <sub>2</sub> = Sulfur Dioxide; PM10 = Particulate Matter 10 microns in diameter or less; PM2.5 = Particulate Matter 2.5 microns in diameter or less Note: Total values are from CalEEMod and may not add up 100 percent due to rounding. 1. The highest values between summer and winter results were used as a worst-case scenario. Source: CalEEMod version 2022.1. See to <b>Appendix A</b> for model outputs.						

**Area Source Emissions.** Area source emissions would be generated due to potential BESS architectural coatings, use of consumer products (e.g., cleaning supplies), and landscaping equipment. Default CalEEMod assumptions were utilized.

**Energy Source Emissions.** The Project’s operational activities would not consume natural gas. The Project would consume negligible amounts of electricity for auxiliary equipment, such as BESS heating, ventilation, and air conditioning (HVAC) units, communications equipment, and lighting. It is assumed that electricity demand would be met by solar energy collected at the Project Site; therefore, zero emissions have been accounted for.

Mobile Source Emissions. Mobile sources are emissions from motor vehicles, including tailpipe and evaporative emissions. Depending upon the pollutant being discussed, the potential air quality impact may be of either regional or local concern. For example, ROG, NO<sub>x</sub>, SO<sub>x</sub>, PM10, and PM2.5 are all pollutants of regional concern (NO<sub>x</sub> and ROG react with sunlight to form O<sub>3</sub> [photochemical smog], and wind currents readily transport SO<sub>x</sub>, PM10, and PM2.5); however, CO tends to be a localized pollutant, dispersing rapidly at the source. During operations, the Project would generate minimal periodic operational vehicle trips internal to the Project Site for required maintenance activities. During operations, it is estimated that the Project would require 6 maintenance-related round trips and up to 4 solar panel and inverter washing roundtrips per year, resulting in approximately 10 total roundtrips per year (20 one-way trips). For purposes of a worse-case analysis assuming a maximum operational day, the model assumes that all 20 one-way trips would occur in one day; refer to **Appendix A** for assumptions and calculations.

#### Total Operational Emissions

As shown in **Table 7** and **Table 8**, estimated total Project operational emissions would not exceed established MDAQMD thresholds. Therefore, impacts associated with Project operational emissions would be less than significant.

#### **Air Quality Health Impacts**

Adverse health effects induced by criteria pollutant emissions are highly dependent on a multitude of interconnected variables (e.g., cumulative concentrations, local meteorology and atmospheric conditions, and the number and character of exposed individual [e.g., age, gender]). In particular, ozone precursors VOCs and NO<sub>x</sub> affect air quality on a regional scale. Health effects related to O<sub>3</sub> are therefore the product of emissions generated by numerous sources throughout a region. Existing models have limited sensitivity to small changes in criteria pollutant concentrations, and, as such, translating criteria pollutants generated by an individual project to specific health effects or additional days of nonattainment would produce meaningless results. The NAAQS and CAAQS are set to be protective of human health, however, which means that the Project's less than significant increases in regional air pollution from criteria air pollutants would have less than significant impacts on human health.

The MDAQMD does not have clear thresholds or methodology to quantify health impacts of criteria pollutants from individual projects. Other air districts, including the South Coast Air Quality Management District (SCAQMD) has stated that it would be extremely difficult, if not impossible to quantify health impacts of criteria pollutants from individual projects for various reasons including modeling limitations as well as the fact that certain emissions are the result of chemical interactions,

and it is impossible to determine exactly where in the atmosphere precursor air pollutants will interact.<sup>14</sup>

The SCAQMD acknowledges that health effects quantification from O<sub>3</sub>, as an example, is correlated with the increases in ambient level of O<sub>3</sub> in the air (concentration) that an individual person breathes. SCAQMD has written that it would take a large amount of additional emissions to cause a modeled increase in ambient O<sub>3</sub> levels over the entire region. The SCAQMD states that based on their own modeling in the SCAQMD's 2012 Air Quality Management Plan, a reduction of 432 tons (864,000 pounds) per day of NO<sub>x</sub> and a reduction of 187 tons (374,000 pounds) per day of VOCs would reduce ozone levels at the site with the highest O<sub>3</sub> levels by only nine parts per billion. As such, the SCAQMD concludes that it is not currently possible to accurately quantify ozone-related health impacts caused by NO<sub>x</sub> or VOC emissions from relatively small projects (defined as projects with less than a regional scope) due to photochemistry and regional model limitations.

Because the Project would not exceed MDAQMD's health-protective thresholds for construction and operational air emissions, the Project would have a less than significant impact for air quality health impacts as well and no modeling of health impacts was performed.

### **Decommissioning**

At the end of the Project's operational term, the Applicant may determine that the Project should be decommissioned and deconstructed. Pursuant to San Bernardino County Development Code Section 84.29.070, the Applicant will work with the County to ensure decommissioning of the Project after its productive lifetime complies with all applicable local, State, and federal requirements and BMPs. The Project would include BMPs to ensure the collection and recycling of modules and to avoid the potential for modules to be disposed of as municipal waste.

Equipment would be de-energized prior to removal, salvaged (where possible), placed in appropriate shipping containers, and secured in a truck transport trailer for shipment off site to be recycled or disposed of at an appropriately licensed disposal facility. Site infrastructure would be removed, including fences and concrete pads that may support the inverters and related equipment. The exterior fencing would be removed, and materials would be recycled to the extent feasible. Project internal and access roads would be restored to their pre-construction condition to the extent feasible unless the landowner elects to retain the improved roads for access throughout the property. A collection, reuse, and recycling program would be utilized to promote reuse and recycling of Project components and minimize disposal in landfills.

While decommissioning would likely take the same or fewer months than construction and involve less construction equipment and workers on a daily basis, for the purposes of presenting a

---

<sup>14</sup> South Coast Air Quality Management District, *Application of the South Coast Air Quality Management District for Leave to File Brief of Amicus Curiae in Support of Neither Party and Brief of Amicus Curiae. In the Supreme Court of California. Sierra Club, Revive the San Joaquin, and League of Women Voters of Fresno v. County of Fresno*, 2014.

conservative analysis, it was assumed that Project decommissioning would generate the same emissions as Project construction. As shown in **Table 5** and **Table 6** emissions would not exceed MDAQMD thresholds and impacts would be less than significant.

## **Cumulative Impacts**

### Cumulative Short-Term Construction Impacts

With respect to the Project's construction-period air quality emissions and cumulative Mojave Desert Air Basin-wide conditions, the MDAQMD has developed strategies to reduce criteria pollutant emissions outlined in the AQMPs pursuant to CAA mandates. As such, the Project would comply with MDAQMD Rule 403 greatest requirements and implement all applicable MDAQMD rules to reduce construction air emissions to the extent feasible. MDAQMD Rule 403 requires that fugitive dust be controlled with the best available control measures in order to reduce dust so that it does not remain visible in the atmosphere beyond the property line of the Project Site. Examples of best available control measures for dust include the application of water and soil stabilizers, covering of loads, avoiding track out onto public roads, and the minimization of non-essential grading during high wind conditions. In addition, the Project would comply with adopted AQMP emissions control measures. Implementation of MDAQMD Rule 403 and the AQMP emissions control measures would help the Project further reduce emissions from construction activities. Pursuant to MDAQMD rules and mandates, these same requirements (i.e., Rule 403 compliance and compliance with adopted AQMP emissions control measures) would also be imposed on construction projects throughout the Mojave Desert Air Basin, which would include potential cumulative projects.

As discussed in **Table 5** and **Table 6** above, the Project's estimated short-term construction emissions would be below the MDAQMD thresholds and would result in less than significant air quality impacts. Thus, the Project's construction emissions would not contribute to a cumulatively considerable air quality impact for nonattainment criteria pollutants in the Mojave Desert Air Basin, and impacts would be less than significant.

### Cumulative Long-Term Operational Impacts

As discussed in **Table 7** and **Table 8**, the Project would not result in long-term operational air quality impacts. Additionally, adherence to MDAQMD rules and regulations alleviate cumulatively considerable contributions to potential significant impacts related to cumulative conditions on a project-by-project basis. Emission reduction technology, strategies, and plans are constantly being developed to address existing significant cumulative impacts. As a result, the Project would not contribute a cumulatively considerable net increase of any nonattainment criteria pollutant, and impacts would be less than significant.

**Impact Determination:** Less Than Significant Impact.

**Mitigation Measures:** No mitigation is required.

**Impact AQ-3: Would the Project expose sensitive receptors to substantial pollutant concentrations?**

Sensitive receptors are defined as facilities or land uses that include members of the population that are particularly sensitive to the effects of air pollutants, such as children, the elderly, and people with illnesses. Examples of these sensitive receptors are residences, schools, hospitals, parks, daycare centers. CARB has identified the following groups of individuals as the most likely to be affected by air pollution: the elderly over 65, children under 14, athletes, and persons with cardiovascular and chronic respiratory diseases such as asthma, emphysema, and bronchitis. The nearest sensitive receptor to the Project Site is a residential use located approximately 220 feet south of the Project Site. No schools, hospitals, or parks are located within two miles of the Project Site.

**Construction**

Project construction is anticipated to be completed over a period of approximately nine months.<sup>15</sup> Project construction activities are anticipated to involve the operation of diesel-powered equipment, which would emit Diesel Particulate Matter (DPM). In 1998, the CARB identified diesel exhaust as a toxic air contaminant (TAC). Cancer health risks associated with exposures to diesel exhaust typically are associated with chronic exposure, in which a 30-year exposure period often is assumed. Project construction would comply with the California Code of Regulations (CCR), Title 13, Section 2449(d)(3) and 2485, which minimizes the idling time of construction equipment either by shutting it off when not in use or by reducing the time of idling to not more than five minutes. Implementation of these regulations would reduce the amount of DPM emissions from Project construction.

Furthermore, construction activities are expected to occur well below the 30-year exposure period used in health risk assessments. Emissions would be short-term and intermittent in nature, and therefore would not generate TAC emissions at high enough exposure concentrations to represent a health hazard. Therefore, construction of the Project would not result in a significant increase in elevated cancer risk to nearby sensitive receptors and impacts would be less than significant.

**Operations**

Typical O&M activities during Project operations include, but are not limited to, facility monitoring; administration and reporting; remote operations of inverters, BESS system, and other equipment; repair and maintenance of solar facilities, electrical transmission lines, and other Project facilities; and periodic panel washing. None of these activities would result in the generation of excessive TAC emissions, or associated health risks. Therefore, operation of the Project is not anticipated to result in an elevated cancer risk to nearby sensitive receptors and potential impacts would be less than significant.

---

<sup>15</sup> Note that the modeling does not account for testing, commissioning, and cleanup as heavy-duty construction equipment would not be utilized.



### Carbon Monoxide Hotspots

CO emissions are a function of vehicle idling time, meteorological conditions, and traffic flow. Under certain extreme meteorological conditions, CO concentrations near a congested roadway or intersection may reach unhealthful levels (i.e., adversely affecting residents, school children, hospital patients, the elderly, etc.). CO is primarily a product of incomplete combustion of gaseous or liquid fuels, meaning tailpipe emissions are worse in stop-and-go congested traffic as compared to free flowing conditions. The Project does not include any stationary sources of combustion, and results in a net increase of approximately 10 maintenance and solar panel washing roundtrips per year (20 one-way trips). The Project is not located near existing CO hotspots and the trips associated with the Project are insufficient to create a CO hotspot.

With such low existing ambient levels of CO, low levels of CO emissions from the Project, and lack of congested roadways around the Project, the Project would not cause CO hotspots in excess of applicable NAAQS or CAAQS standards at any intersections within the County. Impacts would be less than significant in this regard.

### Naturally Occurring Asbestos

Asbestos is a term used for several types of naturally occurring fibrous minerals that are a human health hazard when airborne. The most common type of asbestos is chrysotile, but other types such as tremolite and actinolite are also found in California. Asbestos is classified as a known human carcinogen by federal, State, and international agencies and was identified as a toxic air contaminant by the California Air Resources Board (CARB) in 1986. Asbestos can be released from serpentinite and ultramafic rocks when the rock is broken or crushed. At the point of release, the asbestos fibers may become airborne, causing air quality and human health hazards. These rocks have been commonly used for unpaved gravel roads, landscaping, fill projects, and other improvement projects in some localities.

According to the Department of Conservation Division of Mines and Geology, *A General Location Guide for Ultramafic Rocks in California – Areas More Likely to Contain Naturally Occurring Asbestos Report* (August 2000), serpentinite and ultramafic rocks do not occur within the vicinity of the Project Site. Thus, there would be no impact in this regard.

### **Valley Fever**

Coccidioidomycosis (CM), often referred to as San Joaquin Valley Fever or Valley Fever, commonly affects people who live in hot dry areas with alkaline soil and varies with the season. This disease, which affects both humans and animals, is caused by inhalation of arthroconidia (spores) of the fungus *Coccidioides immitis* (CI). CI spores are found in the top 2-to-12 inches of soil and the existence of the fungus in most soil areas is temporary. The cocci fungus lives as a saprophyte in dry, alkaline soil. When weather and moisture conditions are favorable, the fungus “blooms” and forms many tiny spores that lie dormant in the soil until they are stirred up by wind, vehicles, excavation, or other

ground-moving activities and become airborne. Agricultural workers, construction workers, and other people who work outdoors and who are exposed to wind and dust are more likely to contract Valley Fever. Children and adults whose hobbies or sports activities expose them to wind and dust are also more likely to contract Valley Fever.

The fungus is known to live in the soil in the southwestern United States and parts of Mexico and Central and South America. People and animals can get sick when they breathe in dust that contains the Valley fever fungus. This fungus infects the lungs and can cause respiratory symptoms including cough, fever, chest pain, and tiredness. In California, the number of reported Valley fever cases has greatly increased in recent years. The number of Valley Fever cases in the United States has been steadily increasing over the past few years. There were over 20,000 reported cases in 2019, and the Center for Disease Control and Prevention (CDC) estimates that an additional 150,000 cases go undiagnosed each year. About 32 percent of all cases occur in California.<sup>16</sup> In 2016, there were 45 cases of Valley Fever in San Bernardino County, an incidence rate of 2.1 cases per 100,000 people.<sup>17</sup>

When a susceptible human who is not immune inhales these airborne spores, they enter the lungs and may cause respiratory infections, such as pneumonia. Roughly 60 percent of individuals infected with CI have no symptoms. For the remaining 40 percent, a wide spectrum of clinical symptoms can occur. The most common presentation of CM is a mild, influenza-like illness while the more severe includes pneumonia-like symptoms requiring rest and medication (fungus-killing medicines). The symptoms of the disease typically begin about two weeks after inhaling the spores. These symptoms typically include flu-like symptoms such as fever, aching, chills, sweats, fatigue, cough, and headache. In uncomplicated CM, symptoms usually subside in a few weeks or months.

In approximately one percent of infected persons, disseminated disease develops, in which CM is spread from the lungs to other areas of the body such as the skin, bones, brain, or other organs. This spreading of CM infection beyond the lungs can be fatal. Meningitis, the most lethal complication of disseminated CM, may cause a stiff neck, severe and persistent headache, nausea, vomiting, and various other central nervous system symptoms such as disorientation, loss of balance or equilibrium, inability to think clearly and loss of consciousness. People with diabetes and women who contract CM while they are pregnant are particularly prone to dissemination of the disease.

Currently, no vaccine is available to prevent this infection. Further, there is no effective way to detect and monitor CI growth patterns in the soil. Thus, controlling the growth of the fungus in the environment to reduce the risk to individuals is currently not a viable option. A skin test can be conducted to identify individuals who have been infected in the past and would have developed immunity to the fungus, although recurrence as a result of immuno-suppression is possible. Even if

---

<sup>16</sup> Center for Disease Control and Prevention, Valley Fever (Coccidioidomycosis) Statistics, <https://www.cdc.gov/fungal/diseases/coccidioidomycosis/statistics.html>, accessed January 2, 2024.

<sup>17</sup> San Bernardino County Coccidioidomycosis Fact Sheet, <https://wp.sbcounty.gov/dph/wp-content/uploads/sites/7/2017/06/News-Coccidioidomycosis-6.1.17.pdf>, accessed January 2, 2024.

the fungus is present in soil, earthmoving activities may not result in increased incidence of valley fever. Propagation of *Coccidioides* is dependent on climatic conditions, with the potential for growth and surface exposure highest following early seasonal rains and long dry spells.

To reduce exposure to CI, development projects implement measures to prevent wind dispersion of arthrospores, such as applying dust control palliatives, water, or vegetation to fungus-bearing soils. To facilitate early identification of infection and subsequent treatment. To facilitate early identification of infection and subsequent treatment, the San Bernardino County Department of Public Health Division of Environmental Health Service recommends using dust suppression methods include wetting the soil during work or covering bare soil.

The California Department of Public Health recommends stopping outside activity during conditions where the dust cannot be controlled well. Appropriate use of respiratory protection may be also needed in some circumstances.

During ground disturbing activities associated with Project construction, the potential exists that such activities could disturb dust particles and, if present, CI spores, which could then be released into the air and potentially be inhaled by on-site workers and nearby sensitive receptors; exposure to these spores can cause Valley Fever. Impacts during Project construction related to CI spores would be potentially significant.

MDAQMD Rule 403 requires that fugitive dust be controlled with the best available control measures in order to reduce dust so that it does not remain visible in the atmosphere beyond the property line of the Project Site. Examples of best available control measures for dust include the application of water and soil stabilizers, covering of loads, avoiding track into public roads, and the minimization of non-essential grading during high-wind conditions. Due to the distance of the nearest sensitive receptor, the Project is not anticipated to exacerbate the risk of existing sensitive receptors to contract Valley Fever. Although CEQA does not require the analysis of a Project's impacts on its construction workers, such analysis is included for informational purposes. The best approaches to reducing construction workers' risk of contracting Valley Fever are awareness and dust reduction because dust can be an indicator that increased efforts are needed to control other airborne particulates (including CI spores, if any). Compliance with MDAQMD rules reduce dust. For example, MDAQMD Rule 401 prohibits a person from discharging into the atmosphere any air emission contaminant for a period or periods aggregating more than three minutes in any single hour emissions that is: (a) as dark or darker in shade as that designated as No. 1 on the Ringelmann Chart, as published by the U.S. Bureau of Mines; or (b) of such opacity as to obscure an observer's view to a degree equal to or greater than 20 percent opacity. Rule 402 prohibits the discharge of air contaminants in quantities that would cause injury, detriment, nuisance, or annoyance to any considerable number of persons or to the public, or that endanger the comfort, repose, health, or safety of any such persons or the public. Additionally, the Project would be required to provide training and awareness of Valley Fever via **Mitigation Measure (MM) AQ-1**. **MM AQ-1** would further ensure worker safety through

education and ensuring implementation of required Occupational Safety and Health Administration (OSHA) safety measures.

With the implementation of **MM AQ-1**, the potential for the release of CI spores, if present, and the associated potential for workers or nearby residents to contract Valley Fever from Project construction activities would be minimized. Accordingly, the Project would not add significantly to the existing exposure level of construction workers or nearby residents to the CI fungus. Therefore, potential impacts would be less than significant with mitigation incorporated.

**Impact Determination:** Potentially Significant Impact.

**Mitigation Measure:**

**MM AQ-1:** Prior to ground disturbance activities, the Applicant must prepare a Valley Fever Management Plan (VFMP), including a Valley Fever training program, to be implemented during construction to address potential risks from *Coccidioides immitis* by minimizing the potential for unsafe dust exposure during construction. The VFMP will identify best management practices including:

- Development of an educational Valley Fever Training Handout for distribution to onsite workers, which should include general information about the causes, symptoms, and treatment instructions regarding Valley Fever, including contact information of local health departments and clinics knowledgeable about Valley Fever.
- Conducting Valley Fever training sessions to educate all Project construction workers regarding appropriate dust management and safety procedures, symptoms of Valley Fever, testing and treatment options. This training must be completed by all workers and visitors (expected to be on-site for more than 2 days) prior to participating in or working in proximity to any ground disturbing activities. Signed documentation of successful completion of the training is to be kept on-site for the duration of construction.
- Developing a job-specific Job Hazard Analyses (JHA), in accordance with Cal/OSHA regulations, to analyze the risk of worker exposure to dust, and maintain and manage safety supplies identified by the JHA.
- Provide and/or require, if determined to be needed based on the applicable JHA, National Institute for Occupational Safety and Health-approved half-face respirators equipped with a minimum N-95 protection factor for use during worker collocation with surface disturbance activities, following completion of medical evaluations, fit-testing, and proper training on use of respirators.

With implementation of **MM AQ-1**, potentially significant impacts related to sensitive receptor pollutant exposure related to Valley Fever would be reduced to less than significant levels.

**Impact AQ-4: Would the Project result in other emissions (such as those leading to odors) adversely affecting a substantial number of people?**

According to the CARB's *CEQA Air Quality Handbook*, land uses associated with odor complaints typically include agricultural uses, wastewater treatment plants, food processing plants, chemical plants, composting, refineries, landfills, dairies, and fiberglass molding. The Project includes construction of a solar PV and energy storage facility and does not include any uses identified by the CARB as being associated with odors.

Project construction activities may generate detectable odors from heavy-duty equipment exhaust. However, construction-related odors would be short-term in nature and cease upon completion of Project construction. Further, the nearest potential residence is too far from the Project Site to detect construction odors. In addition, the Project would be required to comply with the CCR, Title 13, Sections 2449(d)(3) and 2485, which minimizes the idling time of construction equipment either by shutting it off when not in use or by reducing the time of idling to no more than five minutes. This would further reduce the detectable odors, if any, from heavy-duty equipment exhaust. Therefore, potential impacts would be short-term and are considered less than significant.

As previously noted, land uses associated with odor complaints do not typically include PV electricity generation and energy storage facilities. During operations, the Project would generate minimal periodic operational vehicle trips internal to the Project Site for required maintenance activities.

It is estimated that the Project would require 6 maintenance-related visits per year, resulting in up to 4 solar panel and inverter washing visits per year, resulting in 10 total annual roundtrips (20 one-way trips). Project operational vehicle trips would be minimal and not of sufficient number to create concentrations of odorous fumes to form and cause a nuisance. As such, potential impacts would be easily dispersed in the atmosphere and are less than significant.

**Impact Determination:** Less Than Significant Impact.

**Mitigation Measures:** No mitigation is required.

**REFERENCES**

California Air Resources Board, *ADAM Air Quality Data Statistics*, <http://www.arb.ca.gov/adam/>, accessed January 2, 2024.

California Air Resources Board, Annual Network Plan, Covering Monitoring Operations in 25 California Air Districts, <https://www.mdaqmd.ca.gov/home/showpublisheddocument/5982/636710697943470000>, accessed January 2, 2024.

California Air Resources Board, *AQMIS2: Air Quality Data*, <https://www.arb.ca.gov/aqmis2/aqdselect.php>, accessed January 2, 2024.

California Air Resources Board, Quality Assurance Air Monitoring Site Information, Site Information for Barstow, [https://ww3.arb.ca.gov/qaweb/iframe\\_site.php?s\\_arb\\_code=36155](https://ww3.arb.ca.gov/qaweb/iframe_site.php?s_arb_code=36155), accessed January 2, 2024.

California Air Resources Board, Quality Assurance Air Monitoring Site Information, Site Information for Hesperia, [https://ww3.arb.ca.gov/qaweb/iframe\\_site.php?s\\_arb\\_code=36201](https://ww3.arb.ca.gov/qaweb/iframe_site.php?s_arb_code=36201), accessed January 2, 2024.

California Air Resources Board, Quality Assurance Air Monitoring Site Information, Site Information for Victorville – Park Avenue, [https://ww3.arb.ca.gov/qaweb/iframe\\_site.php?s\\_arb\\_code=36306](https://ww3.arb.ca.gov/qaweb/iframe_site.php?s_arb_code=36306), accessed January 2, 2024.

Center for Disease Control and Prevention, Valley Fever (Coccidioidomycosis) Statistics, <https://www.cdc.gov/fungal/diseases/coccidioidomycosis/statistics.html>, accessed January 2, 2024.

Mojave Desert Air Quality Management District, Ambient Air Quality Monitoring, <http://mdaqmd.ca.gov/air-quality/monitoring-info>, accessed January 2, 2024.

Mojave Desert Air Quality Management District, California Environmental Quality Act (CEQA) and Federal Conformity Guidelines, February 2020.

San Bernardino County, Coccidioidomycosis Fact Sheet, <https://wp.sbcounty.gov/dph/wp-content/uploads/sites/7/2017/06/News-Coccidioidomycosis-6.1.17.pdf>, accessed January 2, 2024.

San Bernardino County, Land Use Service Zoning Maps, Interactive Zoning Layer, <https://lus.sbcounty.gov/planning-home/zoning-and-overlay-maps/zoning-maps/>, accessed on January 2, 2024.

San Joaquin Valley Air Pollution Control District, *Application for Leave to File Brief of Amicus Curiae Brief of San Joaquin Valley Unified Air Pollution Control District in Support of Defendant and Respondent, County of Fresno and Real Party In Interest and Respondent, Friant Ranch, L.P. In the Supreme Court of California. Sierra Club, Revive the San Joaquin, and League of Women Voters of Fresno v. County of Fresno, 2014.*

South Coast Air Quality Management District, *Application of the South Coast Air Quality Management District for Leave to File Brief of Amicus Curiae in Support of Neither Party and Brief of Amicus Curiae. In the Supreme Court of California. Sierra Club, Revive the San Joaquin, and League of Women Voters of Fresno v. County of Fresno, 2014.*

Southern California Association of Governments, 2016-2040 Regional Transportation Plan/Sustainable Communities Strategy Demographics & Growth Forecast, April 2016.

State of California Department of Finance, E-5 Population and Housing Estimates for Cities, Counties, and the State, January 2020-2023 with 2023 Benchmark, May 2023. <https://dof.ca.gov/forecasting/demographics/estimates/e-5-population-and-housing-estimates-for-cities-counties-and-the-state-2020-2023/>, accessed January 2, 2024.

United States Environmental Protection Agency, *Carbon Monoxide Emissions*, [https://cfpub.epa.gov/roe/indicator\\_pdf.cfm?i=10](https://cfpub.epa.gov/roe/indicator_pdf.cfm?i=10), accessed January 2, 2024.

# Appendix A

---

## Air Quality Emissions Data



**Sunrise**

<b>Phase</b>	<b>Start Date</b>	<b>End Date</b>	<b>Work Days</b>
Demolition	10/1/2025	10/22/2025	15
Site Preparation	10/23/2025	11/27/2025	25
Grading	11/28/2025	1/9/2026	30
Paving	1/10/2026	1/24/2026	10
Construction	1/25/2026	4/12/2026	55
PV Panel v	4/13/2026	5/30/2026	34

## Sunrise Road Equipment List

<b>Demolition</b>	
Dozer	2
Excavator	3
Concrete/industrial straws	1
<b>Site Preparation</b>	
Tractor/loader/backhoe	1
Dozers	1
<b>Grading</b>	
Excavators	2
Rubber Tired Dozers	2
Off-Highway Trucks	1
Skid Steer Loaders	1
Rollers	2
<b>Construction/Installation</b>	
Cranes	1
Pile driver rig	2
Drill rig	1
Tractors/Loaders/Backhoes	1
Excavators	1
Off-Highway Trucks	1
concrete truck	1
Rubber Tired Dozers	1
Trenchers	1
Skid steer	2
<b>PV Vendor Trips</b>	
Tractor/Loader/Backhoe	1
<b>Paving</b>	
Rollers	1

<b>Worker Trips</b>				
	<b>Distance from Project Site</b>	<b>Population<sup>1</sup></b>	<b>%</b>	<b>Peak Workers</b>
California City	28	14,914	9%	6
Lancaster	50	173,376	92%	64
<b>Totals</b>	<b>78</b>	<b>188,290</b>		<b>70</b>
		<b>Trip Length (miles):</b>	<b>48</b>	
		<b>Estimated Worker Trips<sup>2</sup>:</b>	<b>40</b>	

Notes:

1. California Department of Finance Demographic Research Unit, Report E-5 Population and Housing Estimates for Cities, Counties, and the State, January 1, 2021-2023, 1/1/2023

2. Based on the San Bernardino County Average Vehicle Occupancy rate for home-work trips within the Year 2000 Post-Census Regional Travel Survey, Table 12, prepared by Southern California Association of Governments, dated 2003.

<b>Water Truck Trips (On-Site Wells)</b>				
	<b>Distance Traveled</b>	<b>Trips/Day<sup>1</sup></b>	<b>System Installation (# Days)</b>	<b>Total Trips<sup>2</sup></b>
Site Prep	48	11	0	0
Grading	48	11	0	0
Construction/Installation	48	11	0	0
			<b>Total</b>	<b>-</b>

Notes:

1. Based on a similar Solar and energy storage Project.

2. During 6-month construction, Project will use 13 acre-feet or 4,236,000 gallons. Using similar Project methodology, each water truck would hold an average of 4,697 gallons (4,236,000 gallons/4,697 gallons per truck = 902 trucks total. 902 total trucks / 87 total days site prep grading and construction = 11 trucks per day). Water trucks hold anywhere from 2,000 to as much as 20,000 gallons.

3. Trips assumed as Vendor trips. Distance is 48 miles based on off-site well extraction.

<b>PV Panel Vendor Trips</b>				
	<b>Distance from Project Site</b>	<b>Trips/Day<sup>1</sup></b>	<b>System Installation (# Days)</b>	<b>Total Trips</b>
Port of Long Beach	136	2	48	97

Notes:

1. Another Project assumed 5 trips per day (113 days) from the Port of Long Beach for system installation (130 MW). Since the project is 6.2 MW, scaled down the trips/day to 5% of a similar Project.

**1.8 miles  
to the  
Boron  
Landfill**

Notes:  
CalEEMod Worker Trips: One-Way  
CalEEMod Vendor Trips: One-Way

Operational Trips: The Project would require approximately 10 operational round trips per year (20 one-way trips).

AQ Trip Rate: 0.0508475

GHG Trip Rate: 0.0008

\*2 panel washing, 1 water truck

	Non Res W-O (panel washing)	Non Res O-O (water truck)
Length (miles)	48	4
Purpose and Percentages	66.67	33.33
Fleet Mix	HHD%	100

Notes:

CalEEMod Operational Trips: Roundtrip

The maximum pounds per day in row 11 is summed over overlapping phases, but the maximum tons per phase in row 34 is not summed over overlapping phases.

**Road Construction Emissions Model, Version 9.0.0**

Daily Emission Estimates for -> Sunrise														
Project Phases (Pounds)	ROG (lbs/day)	CO (lbs/day)	NOx (lbs/day)	Total PM10 (lbs/day)	Exhaust PM10 (lbs/day)	Fugitive Dust PM10 (lbs/day)	Total PM2.5 (lbs/day)	Exhaust PM2.5 (lbs/day)	Fugitive Dust PM2.5 (lbs/day)	SOx (lbs/day)	CO2 (lbs/day)	CH4 (lbs/day)	N2O (lbs/day)	CO2e (lbs/day)
Grubbing/Land Clearing	0.68	6.40	6.25	1.27	0.27	1.00	0.45	0.24	0.21	0.02	1,636.60	0.42	0.04	1,658.56
Grading/Excavation	3.53	36.29	35.14	2.47	1.47	1.00	1.47	1.27	0.21	0.10	9,712.83	2.46	0.33	9,872.54
Drainage/Utilities/Sub-Grade	3.03	30.93	27.88	2.13	1.13	1.00	1.24	1.03	0.21	0.07	6,811.87	1.55	0.09	6,876.35
Paving	1.18	17.12	11.59	0.57	0.57	0.00	0.49	0.49	0.00	0.03	3,110.12	0.73	0.10	3,159.27
Maximum (pounds/day)	7.24	73.62	69.27	5.87	2.87	3.00	3.16	2.53	0.62	0.19	18,161.30	4.43	0.45	18,407.44
Total (tons/construction project)	0.03	0.31	0.29	0.02	0.01	0.01	0.01	0.01	0.00	0.00	75.89	0.02	0.00	76.95

Notes:		Project Start Year ->	2025
		Project Length (months) ->	1
		Total Project Area (acres) ->	3
		Maximum Area Disturbed/Day (acres) ->	0
		Water Truck Used? ->	Yes
		Total Material Imported/Exported Volume (yd <sup>3</sup> /day)	
		Daily VMT (miles/day)	
Phase	Soil	Asphalt	Soil Hauling    Asphalt Hauling    Worker Commute    Water Truck
Grubbing/Land Clearing	0	0	0                    0                    200                    40
Grading/Excavation	250	0	390                  0                    720                    40
Drainage/Utilities/Sub-Grade	0	0	0                    0                    600                    40
Paving	0	55	0                    90                    480                    40

PM10 and PM2.5 estimates assume 50% control of fugitive dust from watering and associated dust control measures if a minimum number of water trucks are specified.  
 Total PM10 emissions shown in column F are the sum of exhaust and fugitive dust emissions shown in columns G and H. Total PM2.5 emissions shown in Column I are the sum of exhaust and fugitive dust emissions shown in columns J and K.  
 CO2e emissions are estimated by multiplying mass emissions for each GHG by its global warming potential (GWP), 1, 25 and 298 for CO2, CH4 and N2O, respectively. Total CO2e is then estimated by summing CO2e estimates over all GHGs.

Total Emission Estimates by Phase for -> Sunrise														
Project Phases (Tons for all except CO2e. Metric tonnes for CO2e)	ROG (tons/phase)	CO (tons/phase)	NOx (tons/phase)	Total PM10 (tons/phase)	Exhaust PM10 (tons/phase)	Fugitive Dust PM10 (tons/phase)	Total PM2.5 (tons/phase)	Exhaust PM2.5 (tons/phase)	Fugitive Dust PM2.5 (tons/phase)	SOx (tons/phase)	CO2 (tons/phase)	CH4 (tons/phase)	N2O (tons/phase)	CO2e (MT/phase)
Grubbing/Land Clearing	0.00	0.01	0.01	0.00	0.00	0.00	0.00	0.00	0.00	0.00	1.80	0.00	0.00	1.66
Grading/Excavation	0.02	0.16	0.15	0.01	0.01	0.00	0.01	0.01	0.00	0.00	42.74	0.01	0.00	39.41
Drainage/Utilities/Sub-Grade	0.01	0.12	0.11	0.01	0.00	0.00	0.00	0.00	0.00	0.00	26.23	0.01	0.00	24.02
Paving	0.00	0.03	0.02	0.00	0.00	0.00	0.00	0.00	0.00	0.00	5.13	0.00	0.00	4.73
Maximum (tons/phase)	0.02	0.16	0.15	0.01	0.01	0.00	0.01	0.01	0.00	0.00	42.74	0.01	0.00	39.41
Total (tons/construction project)	0.03	0.31	0.29	0.02	0.01	0.01	0.01	0.01	0.00	0.00	75.89	0.02	0.00	69.81

PM10 and PM2.5 estimates assume 50% control of fugitive dust from watering and associated dust control measures if a minimum number of water trucks are specified.  
 Total PM10 emissions shown in column F are the sum of exhaust and fugitive dust emissions shown in columns G and H. Total PM2.5 emissions shown in Column I are the sum of exhaust and fugitive dust emissions shown in columns J and K.  
 CO2e emissions are estimated by multiplying mass emissions for each GHG by its global warming potential (GWP), 1, 25 and 298 for CO2, CH4 and N2O, respectively. Total CO2e is then estimated by summing CO2e estimates over all GHGs.  
 The CO2e emissions are reported as metric tons per phase.


**Road Construction Emissions Model**      **Version 9.0.0**

**Data Entry Worksheet**

Note: Required data input sections have a yellow background.  
Optional data input sections have a blue background. Only areas with a yellow or blue background can be modified. Program defaults have a white background.  
The user is required to enter information in cells D10 through D24, E28 through G35, and D38 through D41 for all project types.  
Please use "Clear Data Input & User Overrides" button first before changing the Project Type or begin a new project.

**Input Type**

Project Name	Sunrise	
Construction Start Year	2025	Enter a Year between 2014 and 2040 (inclusive)
Project Type	1	1) New Road Construction : Project to build a roadway from bare ground, which generally requires more site preparation than widening an existing roadway 2) Road Widening : Project to add a new lane to an existing roadway 3) Bridge/Overpass Construction : Project to build an elevated roadway, which generally requires some different equipment than a new roadway, such as a crane 4) Other Linear Project Type: Non-roadway project such as a pipeline, transmission line, or levee construction
Project Construction Time	1.00	month
Working Days per Month	22.00	days (assume 22 if unknown)
Predominant Soil/Site Type: Enter 1, 2, or 3 <small>(for project within "Sacramento County", follow soil type selection instructions in cells E18 to E20 otherwise see instructions provided in cells J18 to J22)</small>	1	1) Sand Gravel : Use for quaternary deposits (Delta/West County) 2) Weathered Rock-Earth : Use for Laguna formation (Jackson Highway area) or the lone formation (Scott Road, Rancho Murieta) 3) Blasted Rock : Use for Salt Springs Slate or Copper Hill Volcanics (Folsom South of Highway 50, Rancho Murieta)
Project Length	1.00	mile
Total Project Area	3.00	acres
Maximum Area Disturbed/Day	0.10	acres
Water Trucks Used?	1	1. Yes 2. No



Please note that the soil type instructions provided in cells E18 to E20 are specific to Sacramento County. Maps available from the California Geologic Survey (see weblink below) can be used to determine soil type outside Sacramento County.

[http://www.conservation.ca.gov/cgs/information/geologic\\_mapping/Pages/googlemaps.aspx#regionalseries](http://www.conservation.ca.gov/cgs/information/geologic_mapping/Pages/googlemaps.aspx#regionalseries)

**Material Hauling Quantity Input**

Material Type	Phase	Haul Truck Capacity (yd <sup>3</sup> ) (assume 20 if unknown)	Import Volume (yd <sup>3</sup> /day)	Export Volume (yd <sup>3</sup> /day)
Soil	Grubbing/Land Clearing			
	Grading/Excavation	20.00	0.00	250.00
	Drainage/Utilities/Sub-Grade			
	Paving			
Asphalt	Grubbing/Land Clearing			
	Grading/Excavation			
	Drainage/Utilities/Sub-Grade			
	Paving	20.00	55.00	

**Mitigation Options**

On-road Fleet Emissions Mitigation		<small>Select "2010 and Newer On-road Vehicles Fleet" option when the on-road heavy-duty truck fleet for the project will be limited to vehicles of model year 2010 or newer</small>
Off-road Equipment Emissions Mitigation		<small>Select "20% NOx and 45% Exhaust PM reduction" option if the project will be required to use a lower emitting off-road construction fleet. The SMAQMD Construction Mitigation Calculator can be used to confirm compliance with this mitigation measure (<a href="http://www.airquality.org/Businesses/CEQA-Land-Use-Planning/Mitigation">http://www.airquality.org/Businesses/CEQA-Land-Use-Planning/Mitigation</a>). Select "Tier 4 Equipment" option if some or all off-road equipment used for the project meets CARB Tier 4 Standard</small>

The remaining sections of this sheet contain areas that can be modified by the user, although those modifications are optional.

Note: The program's estimates of construction period phase length can be overridden in cells D50 through D53, and F50 through F53.

Construction Periods	User Override of Construction Months	Program Calculated Months	User Override of Phase Starting Date	Program Default Phase Starting Date
Grubbing/Land Clearing		0.10	9/1/2025	1/1/2025
Grading/Excavation		0.40	9/4/2025	1/5/2025
Drainage/Utilities/Sub-Grade		0.35	9/16/2025	1/18/2025
Paving		0.15	9/26/2025	1/29/2025
<b>Totals (Months)</b>	<b>1</b>			

Note: Soil Hauling emission default values can be overridden in cells D61 through D64, and F61 through F64.

Soil Hauling Emissions		User Override of Miles/Round Trip	Program Estimate of Miles/Round Trip	User Override of Truck Round Trips/Day	Default Values Round Trips/Day	Calculated Daily VMT					
<b>User Input</b>											
Miles/round trip: Grubbing/Land Clearing		30.00			0	0.00					
Miles/round trip: Grading/Excavation		30.00			13	390.00					
Miles/round trip: Drainage/Utilities/Sub-Grade		30.00			0	0.00					
Miles/round trip: Paving		30.00			0	0.00					
<b>Emission Rates</b>		<b>ROG</b>	<b>CO</b>	<b>NOx</b>	<b>PM10</b>	<b>PM2.5</b>	<b>SOx</b>	<b>CO2</b>	<b>CH4</b>	<b>N2O</b>	<b>CO2e</b>
Grubbing/Land Clearing (grams/mile)		0.03	0.41	3.06	0.11	0.05	0.02	1,672.88	0.00	0.26	1,751.28
Grading/Excavation (grams/mile)		0.03	0.41	3.06	0.11	0.05	0.02	1,672.88	0.00	0.26	1,751.28
Drainage/Utilities/Sub-Grade (grams/mile)		0.03	0.41	3.06	0.11	0.05	0.02	1,672.88	0.00	0.26	1,751.28
Paving (grams/mile)		0.03	0.41	3.06	0.11	0.05	0.02	1,672.88	0.00	0.26	1,751.28
Grubbing/Land Clearing (grams/trip)		0.00	0.00	4.46	0.00	0.00	0.00	0.00	0.00	0.00	0.00
Grading/Excavation (grams/trip)		0.00	0.00	4.46	0.00	0.00	0.00	0.00	0.00	0.00	0.00
Drainage/Utilities/Sub-Grade (grams/trip)		0.00	0.00	4.46	0.00	0.00	0.00	0.00	0.00	0.00	0.00
Paving (grams/trip)		0.00	0.00	4.46	0.00	0.00	0.00	0.00	0.00	0.00	0.00
<b>Hauling Emissions</b>		<b>ROG</b>	<b>CO</b>	<b>NOx</b>	<b>PM10</b>	<b>PM2.5</b>	<b>SOx</b>	<b>CO2</b>	<b>CH4</b>	<b>N2O</b>	<b>CO2e</b>
Pounds per day - Grubbing/Land Clearing		0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
Tons per const. Period - Grubbing/Land Clearing		0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
Pounds per day - Grading/Excavation		0.03	0.35	2.76	0.10	0.04	0.01	1,438.35	0.00	0.23	1,505.76
Tons per const. Period - Grading/Excavation		0.00	0.00	0.01	0.00	0.00	0.00	6.33	0.00	0.00	6.63
Pounds per day - Drainage/Utilities/Sub-Grade		0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
Tons per const. Period - Drainage/Utilities/Sub-Grade		0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
Pounds per day - Paving		0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
Tons per const. Period - Paving		0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
Total tons per construction project		0.00	0.00	0.01	0.00	0.00	0.00	6.33	0.00	0.00	6.63

Note: Asphalt Hauling emission default values can be overridden in cells D91 through D94, and F91 through F94.

Asphalt Hauling Emissions		User Override of Miles/Round Trip	Program Estimate of Miles/Round Trip	User Override of Truck Round Trips/Day	Default Values Round Trips/Day	Calculated Daily VMT					
<b>User Input</b>											
Miles/round trip: Grubbing/Land Clearing		30.00			0	0.00					
Miles/round trip: Grading/Excavation		30.00			0	0.00					
Miles/round trip: Drainage/Utilities/Sub-Grade		30.00			0	0.00					
Miles/round trip: Paving		30.00			3	90.00					
<b>Emission Rates</b>		<b>ROG</b>	<b>CO</b>	<b>NOx</b>	<b>PM10</b>	<b>PM2.5</b>	<b>SOx</b>	<b>CO2</b>	<b>CH4</b>	<b>N2O</b>	<b>CO2e</b>
Grubbing/Land Clearing (grams/mile)		0.03	0.41	3.06	0.11	0.05	0.02	1,672.88	0.00	0.26	1,751.28
Grading/Excavation (grams/mile)		0.03	0.41	3.06	0.11	0.05	0.02	1,672.88	0.00	0.26	1,751.28
Drainage/Utilities/Sub-Grade (grams/mile)		0.03	0.41	3.06	0.11	0.05	0.02	1,672.88	0.00	0.26	1,751.28
Paving (grams/mile)		0.03	0.41	3.06	0.11	0.05	0.02	1,672.88	0.00	0.26	1,751.28
Grubbing/Land Clearing (grams/trip)		0.00	0.00	4.46	0.00	0.00	0.00	0.00	0.00	0.00	0.00
Grading/Excavation (grams/trip)		0.00	0.00	4.46	0.00	0.00	0.00	0.00	0.00	0.00	0.00
Drainage/Utilities/Sub-Grade (grams/trip)		0.00	0.00	4.46	0.00	0.00	0.00	0.00	0.00	0.00	0.00
Paving (grams/trip)		0.00	0.00	4.46	0.00	0.00	0.00	0.00	0.00	0.00	0.00
<b>Emissions</b>		<b>ROG</b>	<b>CO</b>	<b>NOx</b>	<b>PM10</b>	<b>PM2.5</b>	<b>SOx</b>	<b>CO2</b>	<b>CH4</b>	<b>N2O</b>	<b>CO2e</b>
Pounds per day - Grubbing/Land Clearing		0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
Tons per const. Period - Grubbing/Land Clearing		0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
Pounds per day - Grading/Excavation		0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
Tons per const. Period - Grading/Excavation		0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
Pounds per day - Drainage/Utilities/Sub-Grade		0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
Tons per const. Period - Drainage/Utilities/Sub-Grade		0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
Pounds per day - Paving		0.01	0.08	0.64	0.02	0.01	0.00	331.93	0.00	0.05	347.48
Tons per const. Period - Paving		0.00	0.00	0.00	0.00	0.00	0.00	0.55	0.00	0.00	0.57
Total tons per construction project		0.00	0.00	0.00	0.00	0.00	0.00	0.55	0.00	0.00	0.57

Note: Worker commute default values can be overridden in cells D121 through D126.

Worker Commute Emissions		User Override of Worker Commute Default Values		Default Values		Calculated		User Override of		Default Values		Calculated	
User Input		Commute Default Values		Daily Trips		Daily VMT		Miles/Round Trip		Miles/Round Trip		Daily VMT	
Miles/ one-way trip			20										
One-way trips/day			2										
No. of employees: Grubbing/Land Clearing			5		10		200.00						
No. of employees: Grading/Excavation			18		36		720.00						
No. of employees: Drainage/Utilities/Sub-Grade			15		30		600.00						
No. of employees: Paving			12		24		480.00						
<b>Emission Rates</b>		<b>ROG</b>	<b>CO</b>	<b>NOx</b>	<b>PM10</b>	<b>PM2.5</b>	<b>SOx</b>	<b>CO2</b>	<b>CH4</b>	<b>N2O</b>	<b>CO2e</b>		
Grubbing/Land Clearing (grams/mile)		0.01	0.78	0.06	0.05	0.02	0.00	295.84	0.00	0.01	297.52		
Grading/Excavation (grams/mile)		0.01	0.78	0.06	0.05	0.02	0.00	295.84	0.00	0.01	297.52		
Draining/Utilities/Sub-Grade (grams/mile)		0.01	0.78	0.06	0.05	0.02	0.00	295.84	0.00	0.01	297.52		
Paving (grams/mile)		0.01	0.78	0.06	0.05	0.02	0.00	295.84	0.00	0.01	297.52		
Grubbing/Land Clearing (grams/trip)		0.93	2.56	0.25	0.00	0.00	0.00	63.73	0.06	0.03	73.77		
Grading/Excavation (grams/trip)		0.93	2.56	0.25	0.00	0.00	0.00	63.73	0.06	0.03	73.77		
Draining/Utilities/Sub-Grade (grams/trip)		0.93	2.56	0.25	0.00	0.00	0.00	63.73	0.06	0.03	73.77		
Paving (grams/trip)		0.93	2.56	0.25	0.00	0.00	0.00	63.73	0.06	0.03	73.77		
<b>Emissions</b>		<b>ROG</b>	<b>CO</b>	<b>NOx</b>	<b>PM10</b>	<b>PM2.5</b>	<b>SOx</b>	<b>CO2</b>	<b>CH4</b>	<b>N2O</b>	<b>CO2e</b>		
Pounds per day - Grubbing/Land Clearing		0.03	0.40	0.03	0.02	0.01	0.00	131.85	0.00	0.00	132.81		
Tons per const. Period - Grubbing/Land Clearing		0.00	0.00	0.00	0.00	0.00	0.00	0.15	0.00	0.00	0.15		
Pounds per day - Grading/Excavation		0.09	1.43	0.11	0.07	0.03	0.00	474.65	0.01	0.01	478.12		
Tons per const. Period - Grading/Excavation		0.00	0.01	0.00	0.00	0.00	0.00	2.09	0.00	0.00	2.10		
Pounds per day - Drainage/Utilities/Sub-Grade		0.08	1.20	0.09	0.06	0.03	0.00	395.54	0.01	0.01	398.43		
Tons per const. Period - Drainage/Utilities/Sub-Grade		0.00	0.00	0.00	0.00	0.00	0.00	1.52	0.00	0.00	1.53		
Pounds per day - Paving		0.06	0.96	0.07	0.05	0.02	0.00	316.43	0.01	0.01	318.75		
Tons per const. Period - Paving		0.00	0.00	0.00	0.00	0.00	0.00	0.52	0.00	0.00	0.53		
Total tons per construction project		0.00	0.01	0.00	0.00	0.00	0.00	4.28	0.00	0.00	4.31		

Note: Water Truck default values can be overridden in cells D153 through D156, I153 through I156, and F153 through F156.

Water Truck Emissions		User Override of Program Estimate of		User Override of Truck		Default Values		Calculated		User Override of		Default Values		Calculated	
User Input		Number of Water Trucks		Round Trips/Vehicle/Day		Round Trips/Vehicle/Day		Trips/day		Miles/Round Trip		Miles/Round Trip		Daily VMT	
Grubbing/Land Clearing - Exhaust			1			5	5		5		8.00		40.00		
Grading/Excavation - Exhaust			1			5	5		5		8.00		40.00		
Drainage/Utilities/Subgrade			1			5	5		5		8.00		40.00		
Paving			1			5	5		5		8.00		40.00		
<b>Emission Rates</b>		<b>ROG</b>	<b>CO</b>	<b>NOx</b>	<b>PM10</b>	<b>PM2.5</b>	<b>SOx</b>	<b>CO2</b>	<b>CH4</b>	<b>N2O</b>	<b>CO2e</b>				
Grubbing/Land Clearing (grams/mile)		0.03	0.41	3.06	0.11	0.05	0.02	1,672.88	0.00	0.26	1,751.28				
Grading/Excavation (grams/mile)		0.03	0.41	3.06	0.11	0.05	0.02	1,672.88	0.00	0.26	1,751.28				
Draining/Utilities/Sub-Grade (grams/mile)		0.03	0.41	3.06	0.11	0.05	0.02	1,672.88	0.00	0.26	1,751.28				
Paving (grams/mile)		0.03	0.41	3.06	0.11	0.05	0.02	1,672.88	0.00	0.26	1,751.28				
Grubbing/Land Clearing (grams/trip)		0.00	0.00	4.46	0.00	0.00	0.00	0.00	0.00	0.00	0.00				
Grading/Excavation (grams/trip)		0.00	0.00	4.46	0.00	0.00	0.00	0.00	0.00	0.00	0.00				
Draining/Utilities/Sub-Grade (grams/trip)		0.00	0.00	4.46	0.00	0.00	0.00	0.00	0.00	0.00	0.00				
Paving (grams/trip)		0.00	0.00	4.46	0.00	0.00	0.00	0.00	0.00	0.00	0.00				
<b>Emissions</b>		<b>ROG</b>	<b>CO</b>	<b>NOx</b>	<b>PM10</b>	<b>PM2.5</b>	<b>SOx</b>	<b>CO2</b>	<b>CH4</b>	<b>N2O</b>	<b>CO2e</b>				
Pounds per day - Grubbing/Land Clearing		0.00	0.04	0.32	0.01	0.00	0.00	147.52	0.00	0.02	154.44				
Tons per const. Period - Grubbing/Land Clearing		0.00	0.00	0.00	0.00	0.00	0.00	0.16	0.00	0.00	0.17				
Pounds per day - Grading/Excavation		0.00	0.04	0.32	0.01	0.00	0.00	147.52	0.00	0.02	154.44				
Tons per const. Period - Grading/Excavation		0.00	0.00	0.00	0.00	0.00	0.00	0.65	0.00	0.00	0.68				
Pounds per day - Drainage/Utilities/Sub-Grade		0.00	0.04	0.32	0.01	0.00	0.00	147.52	0.00	0.02	154.44				
Tons per const. Period - Drainage/Utilities/Sub-Grade		0.00	0.00	0.00	0.00	0.00	0.00	0.57	0.00	0.00	0.59				
Pounds per day - Paving		0.00	0.04	0.32	0.01	0.00	0.00	147.52	0.00	0.02	154.44				
Tons per const. Period - Paving		0.00	0.00	0.00	0.00	0.00	0.00	0.24	0.00	0.00	0.25				
Total tons per construction project		0.00	0.00	0.00	0.00	0.00	0.00	1.62	0.00	0.00	1.70				

Note: Fugitive dust default values can be overridden in cells D183 through D185.

Fugitive Dust		User Override of Max Acreage Disturbed/Day		Default Maximum Acreage/Day		PM10		PM2.5	
						pounds/day		tons/per period	
Fugitive Dust - Grubbing/Land Clearing			0.10			1.00	0.00	0.21	0.00
Fugitive Dust - Grading/Excavation			0.10			1.00	0.00	0.21	0.00
Fugitive Dust - Drainage/Utilities/Subgrade			0.10			1.00	0.00	0.21	0.00



Off-Road Equipment Emissions														
Grubbing/Land Clearing		Default Number of Vehicles	Override of Mitigation Option	Default	ROG	CO	NOx	PM10	PM2.5	SOx	CO2	CH4	N2O	CO2e
Override of Default Number of Vehicles	Program-estimate	Default Equipment Tier (applicable only when "Tier 4 Mitigation" Option Selected)		Equipment Tier	Type	pounds/day	pounds/day	pounds/day	pounds/day	pounds/day	pounds/day	pounds/day	pounds/day	pounds/day
				Model Default Tier	Aerial Lifts	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
				Model Default Tier	Air Compressors	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
				Model Default Tier	Bore/Drill Rigs	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
				Model Default Tier	Cement and Mortar Mixers	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
				Model Default Tier	Concrete/Industrial Saws	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
				Model Default Tier	Cranes	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	1			Model Default Tier	Crawler Tractors	0.37	2.10	3.96	0.15	0.14	0.01	758.27	0.25	0.01
				Model Default Tier	Crushing/Proc. Equipment	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	1			Model Default Tier	Excavators	0.17	3.26	1.22	0.06	0.06	0.01	500.34	0.16	0.00
				Model Default Tier	Forklifts	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
				Model Default Tier	Generator Sets	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
				Model Default Tier	Graders	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
				Model Default Tier	Off-Highway Tractors	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
				Model Default Tier	Off-Highway Trucks	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
				Model Default Tier	Other Construction Equipment	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
				Model Default Tier	Other General Industrial Equipn	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
				Model Default Tier	Other Material Handling Equipm	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
				Model Default Tier	Pavers	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
				Model Default Tier	Paving Equipment	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
				Model Default Tier	Plate Compactors	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
				Model Default Tier	Pressure Washers	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
				Model Default Tier	Pumps	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
				Model Default Tier	Rollers	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
				Model Default Tier	Rough Terrain Forklifts	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
				Model Default Tier	Rubber Tired Dozers	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
				Model Default Tier	Rubber Tired Loaders	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
				Model Default Tier	Scrapers	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	2			Model Default Tier	Signal Boards	0.11	0.60	0.72	0.03	0.03	0.00	98.63	0.01	0.00
				Model Default Tier	Skid Steer Loaders	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
				Model Default Tier	Surfacing Equipment	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
				Model Default Tier	Sweepers/Scrubbers	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
				Model Default Tier	Tractors/Loaders/Backhoes	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
				Model Default Tier	Trenchers	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
				Model Default Tier	Welders	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
<b>User-Defined Off-road Equipment</b>					If non-default vehicles are used, please provide information in 'Non-default Off-road Equipment' tab									
Number of Vehicles		Equipment Tier		Type	ROG	CO	NOx	PM10	PM2.5	SOx	CO2	CH4	N2O	CO2e
0.00		N/A			0	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
0.00		N/A			0	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
0.00		N/A			0	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
0.00		N/A			0	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
0.00		N/A			0	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
0.00		N/A			0	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
0.00		N/A			0	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	Grubbing/Land Clearing			pounds per day	0.66	5.97	5.90	0.24	0.23	0.01	1,357.23	0.42	0.01	1,371.31
	Grubbing/Land Clearing			tons per phase	0.00	0.01	0.01	0.00	0.00	0.00	1.49	0.00	0.00	1.51

Grading/Excavation		Default Number of Vehicles	Mitigation Option Override of	Default	ROG	CO	NOx	PM10	PM2.5	SOx	CO2	CH4	N2O	CO2e
Override of Default Number of Vehicles		Program-estimate	Default Equipment Tier (applicable only when "Tier 4 Mitigation" Option Selected)	Equipment Tier	Type	pounds/day	pounds/day	pounds/day	pounds/day	pounds/day	pounds/day	pounds/day	pounds/day	pounds/day
				Model Default Tier	Aerial Lifts	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
				Model Default Tier	Air Compressors	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
				Model Default Tier	Bore/Drill Rigs	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
				Model Default Tier	Cement and Mortar Mixers	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
				Model Default Tier	Concrete/Industrial Saws	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	0			Model Default Tier	Cranes	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	1			Model Default Tier	Crawler Tractors	0.37	2.10	3.96	0.15	0.14	0.01	758.27	0.25	766.45
				Model Default Tier	Crushing/Proc. Equipment	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3			Model Default Tier	Excavators	0.50	9.78	3.66	0.18	0.17	0.02	1,501.02	0.49	1,517.20
				Model Default Tier	Forklifts	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
				Model Default Tier	Generator Sets	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	1			Model Default Tier	Graders	0.31	1.59	3.46	0.11	0.10	0.01	640.24	0.21	647.14
				Model Default Tier	Off-Highway Tractors	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
				Model Default Tier	Off-Highway Trucks	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
				Model Default Tier	Other Construction Equipment	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
				Model Default Tier	Other General Industrial Equipm	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
				Model Default Tier	Other Material Handling Equipm	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
				Model Default Tier	Pavers	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
				Model Default Tier	Paving Equipment	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
				Model Default Tier	Plate Compactors	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
				Model Default Tier	Pressure Washers	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
				Model Default Tier	Pumps	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	2			Model Default Tier	Rollers	0.27	3.69	2.89	0.15	0.13	0.01	508.12	0.16	513.60
				Model Default Tier	Rough Terrain Forklifts	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
				Model Default Tier	Rubber Tired Dozers	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	1			Model Default Tier	Rubber Tired Loaders	0.23	1.47	1.86	0.06	0.06	0.01	605.62	0.20	612.16
	2			Model Default Tier	Scrapers	1.34	10.76	12.74	0.50	0.46	0.03	2,936.30	0.95	2,967.95
	2			Model Default Tier	Signal Boards	0.11	0.60	0.72	0.03	0.03	0.00	98.63	0.01	99.13
				Model Default Tier	Skid Steer Loaders	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
				Model Default Tier	Surfacing Equipment	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
				Model Default Tier	Sweepers/Scrubbers	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	2			Model Default Tier	Tractors/Loaders/Backhoes	0.26	4.46	2.67	0.11	0.10	0.01	604.11	0.20	610.61
				Model Default Tier	Trenchers	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
				Model Default Tier	Welders	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
<b>User-Defined Off-road Equipment</b>		<b>If non-default vehicles are used, please provide information in 'Non-default Off-road Equipment' tab</b>			ROG	CO	NOx	PM10	PM2.5	SOx	CO2	CH4	N2O	CO2e
	Number of Vehicles		Equipment Tier	Type	pounds/day	pounds/day	pounds/day	pounds/day	pounds/day	pounds/day	pounds/day	pounds/day	pounds/day	pounds/day
	0.00		N/A		0	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	0.00		N/A		0	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	0.00		N/A		0	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	0.00		N/A		0	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	0.00		N/A		0	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	0.00		N/A		0	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	0.00		N/A		0	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	Grading/Excavation			pounds per day	3.41	34.46	31.95	1.29	1.19	0.08	7,652.31	2.45	0.07	7,734.23
	Grading/Excavation			tons per phase	0.02	0.15	0.14	0.01	0.01	0.00	33.67	0.01	0.00	34.03

Drainage/Utilities/Subgrade		Default Number of Vehicles	Mitigation Option Override of	Default	ROG	CO	NOx	PM10	PM2.5	SOx	CO2	CH4	N2O	CO2e
Override of Default Number of Vehicles		Program-estimate	Default Equipment Tier (applicable only when "Tier 4 Mitigation" Option Selected)	Equipment Tier	pounds/day	pounds/day	pounds/day	pounds/day	pounds/day	pounds/day	pounds/day	pounds/day	pounds/day	pounds/day
		1		Model Default Tier	Aerial Lifts	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
				Model Default Tier	Air Compressors	0.23	2.41	1.53	0.07	0.07	0.00	375.26	0.02	0.00
				Model Default Tier	Bore/Drill Rigs	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
				Model Default Tier	Cement and Mortar Mixers	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
				Model Default Tier	Concrete/Industrial Saws	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
				Model Default Tier	Cranes	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
				Model Default Tier	Crawler Tractors	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
				Model Default Tier	Crushing/Proc. Equipment	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
				Model Default Tier	Excavators	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
				Model Default Tier	Forklifts	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
		1		Model Default Tier	Generator Sets	0.27	3.66	2.40	0.10	0.10	0.01	623.04	0.02	0.00
		1		Model Default Tier	Graders	0.31	1.59	3.46	0.11	0.10	0.01	640.24	0.21	0.01
				Model Default Tier	Off-Highway Tractors	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
				Model Default Tier	Off-Highway Trucks	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
				Model Default Tier	Other Construction Equipment	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
				Model Default Tier	Other General Industrial Equipm	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
				Model Default Tier	Other Material Handling Equipm	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
				Model Default Tier	Pavers	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
				Model Default Tier	Paving Equipment	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
		1		Model Default Tier	Plate Compactors	0.04	0.21	0.25	0.01	0.01	0.00	34.48	0.00	0.00
				Model Default Tier	Pressure Washers	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
		1		Model Default Tier	Pumps	0.29	3.72	2.43	0.10	0.10	0.01	623.04	0.03	0.00
				Model Default Tier	Rollers	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
		1		Model Default Tier	Rough Terrain Forklifts	0.10	2.29	1.28	0.04	0.03	0.00	333.72	0.11	0.00
				Model Default Tier	Rubber Tired Dozers	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
				Model Default Tier	Rubber Tired Loaders	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
		2		Model Default Tier	Scrapers	1.34	10.76	12.74	0.50	0.46	0.03	2,936.30	0.95	0.03
		2		Model Default Tier	Signal Boards	0.11	0.60	0.72	0.03	0.03	0.00	98.63	0.01	0.00
				Model Default Tier	Skid Steer Loaders	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
				Model Default Tier	Surfacing Equipment	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
				Model Default Tier	Sweepers/Scrubbers	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
		2		Model Default Tier	Tractors/Loaders/Backhoes	0.26	4.46	2.67	0.11	0.10	0.01	604.11	0.20	0.01
				Model Default Tier	Trenchers	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
				Model Default Tier	Welders	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
<b>User-Defined Off-road Equipment</b>					ROG	CO	NOx	PM10	PM2.5	SOx	CO2	CH4	N2O	CO2e
Number of Vehicles		If non-default vehicles are used, please provide information in 'Non-default Off-road Equipment' tab			pounds/day	pounds/day	pounds/day	pounds/day	pounds/day	pounds/day	pounds/day	pounds/day	pounds/day	pounds/day
0.00		Equipment Tier	Type	0	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
0.00		N/A		0	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
0.00		N/A		0	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
0.00		N/A		0	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
0.00		N/A		0	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
0.00		N/A		0	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
0.00		N/A		0	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	Drainage/Utilities/Sub-Grade		pounds per day		2.95	29.70	27.47	1.06	1.00	0.07	6,268.81	1.54	0.05	6,323.48
	Drainage/Utilities/Sub-Grade		tons per phase		0.01	0.11	0.11	0.00	0.00	0.00	24.13	0.01	0.00	24.35

Paving		Default Number of Vehicles	Mitigation Option Override of	Default	ROG	CO	NOx	PM10	PM2.5	SOx	CO2	CH4	N2O	CO2e	
Override of Default Number of Vehicles		Program-estimate	Default Equipment Tier (applicable only when "Tier 4 Mitigation" Option Selected)	Equipment Tier	Type	pounds/day	pounds/day	pounds/day	pounds/day	pounds/day	pounds/day	pounds/day	pounds/day	pounds/day	
				Model Default Tier	Aerial Lifts	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
				Model Default Tier	Air Compressors	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
				Model Default Tier	Bore/Drill Rigs	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
				Model Default Tier	Cement and Mortar Mixers	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
				Model Default Tier	Concrete/Industrial Saws	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
				Model Default Tier	Cranes	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
				Model Default Tier	Crawler Tractors	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
				Model Default Tier	Crushing/Proc. Equipment	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
				Model Default Tier	Excavators	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
				Model Default Tier	Forklifts	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
				Model Default Tier	Generator Sets	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
				Model Default Tier	Graders	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
				Model Default Tier	Off-Highway Tractors	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
				Model Default Tier	Off-Highway Trucks	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
				Model Default Tier	Other Construction Equipment	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
				Model Default Tier	Other General Industrial Equipm	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
				Model Default Tier	Other Material Handling Equipm	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
		1		Model Default Tier	Pavers	0.17	2.90	1.58	0.07	0.07	0.00	454.99	0.15	459.90	
		1		Model Default Tier	Paving Equipment	0.15	2.55	1.26	0.06	0.06	0.00	394.32	0.13	398.57	
				Model Default Tier	Plate Compactors	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
				Model Default Tier	Pressure Washers	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
				Model Default Tier	Pumps	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
		3		Model Default Tier	Rollers	0.41	5.54	4.33	0.22	0.20	0.01	762.19	0.25	770.40	
				Model Default Tier	Rough Terrain Forklifts	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
				Model Default Tier	Rubber Tired Dozers	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
				Model Default Tier	Rubber Tired Loaders	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
				Model Default Tier	Scrapers	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
		2		Model Default Tier	Signal Boards	0.11	0.60	0.72	0.03	0.03	0.00	98.63	0.01	99.13	
				Model Default Tier	Skid Steer Loaders	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
				Model Default Tier	Surfacing Equipment	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
				Model Default Tier	Sweepers/Scrubbers	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
		2		Model Default Tier	Tractors/Loaders/Backhoes	0.26	4.46	2.67	0.11	0.10	0.01	604.11	0.20	610.61	
				Model Default Tier	Trenchers	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
				Model Default Tier	Welders	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
<b>User-Defined Off-road Equipment</b>		<i>If non-default vehicles are used, please provide information in 'Non-default Off-road Equipment' tab</i>				ROG	CO	NOx	PM10	PM2.5	SOx	CO2	CH4	N2O	CO2e
	Number of Vehicles		Equipment Tier	Type	pounds/day	pounds/day	pounds/day	pounds/day	pounds/day	pounds/day	pounds/day	pounds/day	pounds/day	pounds/day	pounds/day
	0.00		N/A		0	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	0.00		N/A		0	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	0.00		N/A		0	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	0.00		N/A		0	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	0.00		N/A		0	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	0.00		N/A		0	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	0.00		N/A		0	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	Paving			pounds per day	1.11	16.04	10.57	0.49	0.45	0.02	2,314.24	0.73	0.02	2,338.61	
	Paving			tons per phase	0.00	0.03	0.02	0.00	0.00	0.00	3.82	0.00	0.00	3.86	
<b>Total Emissions all Phases (tons per construction period) =&gt;</b>					0.03	0.30	0.27	0.01	0.01	0.00	63.12	0.02	0.00	63.74	

Equipment default values for horsepower and hours/day can be overridden in cells D403 through D436 and F403 through F436.

Equipment	User Override of Horsepower	Default Values Horsepower	User Override of Hours/day	Default Values Hours/day
Aerial Lifts		63		8
Air Compressors		78		8
Bore/Drill Rigs		221		8
Cement and Mortar Mixers		9		8
Concrete/Industrial Saws		81		8
Cranes		231		8
Crawler Tractors		212		8
Crushing/Proc. Equipment		85		8
Excavators		158		8
Forklifts		89		8
Generator Sets		84		8
Graders		187		8
Off-Highway Tractors		124		8
Off-Highway Trucks		402		8
Other Construction Equipment		172		8
Other General Industrial Equipment		88		8
Other Material Handling Equipment		168		8
Pavers		130		8
Paving Equipment		132		8
Plate Compactors		8		8
Pressure Washers		13		8
Pumps		84		8
Rollers		80		8
Rough Terrain Forklifts		100		8
Rubber Tired Dozers		247		8
Rubber Tired Loaders		203		8
Scrapers		367		8
Signal Boards		6		8
Skid Steer Loaders		65		8
Surfacing Equipment		263		8
Sweepers/Scrubbers		64		8
Tractors/Loaders/Backhoes		97		8
Trenchers		78		8
Welders		46		8

END OF DATA ENTRY SHEET

# RPCA Sunrise Road Solar Project Detailed Report

## Table of Contents

1. Basic Project Information
  - 1.1. Basic Project Information
  - 1.2. Land Use Types
  - 1.3. User-Selected Emission Reduction Measures by Emissions Sector
2. Emissions Summary
  - 2.1. Construction Emissions Compared Against Thresholds
  - 2.2. Construction Emissions by Year, Unmitigated
  - 2.4. Operations Emissions Compared Against Thresholds
  - 2.5. Operations Emissions by Sector, Unmitigated
3. Construction Emissions Details
  - 3.1. Demolition (2025) - Unmitigated
  - 3.3. Site Preparation (2025) - Unmitigated
  - 3.5. Grading (2025) - Unmitigated
  - 3.7. Grading (2026) - Unmitigated
  - 3.9. Construction/Installation (2026) - Unmitigated

3.11. PV vendor trips (2026) - Unmitigated

3.13. Paving (Access Road Installation) (2026) - Unmitigated

#### 4. Operations Emissions Details

4.1. Mobile Emissions by Land Use

4.1.1. Unmitigated

4.2. Energy

4.2.1. Electricity Emissions By Land Use - Unmitigated

4.2.3. Natural Gas Emissions By Land Use - Unmitigated

4.3. Area Emissions by Source

4.3.1. Unmitigated

4.4. Water Emissions by Land Use

4.4.1. Unmitigated

4.5. Waste Emissions by Land Use

4.5.1. Unmitigated

4.6. Refrigerant Emissions by Land Use

4.6.1. Unmitigated

4.7. Offroad Emissions By Equipment Type

4.7.1. Unmitigated

#### 4.8. Stationary Emissions By Equipment Type

##### 4.8.1. Unmitigated

#### 4.9. User Defined Emissions By Equipment Type

##### 4.9.1. Unmitigated

#### 4.10. Soil Carbon Accumulation By Vegetation Type

##### 4.10.1. Soil Carbon Accumulation By Vegetation Type - Unmitigated

##### 4.10.2. Above and Belowground Carbon Accumulation by Land Use Type - Unmitigated

##### 4.10.3. Avoided and Sequestered Emissions by Species - Unmitigated

### 5. Activity Data

#### 5.1. Construction Schedule

#### 5.2. Off-Road Equipment

##### 5.2.1. Unmitigated

#### 5.3. Construction Vehicles

##### 5.3.1. Unmitigated

#### 5.4. Vehicles

##### 5.4.1. Construction Vehicle Control Strategies

#### 5.5. Architectural Coatings

#### 5.6. Dust Mitigation



5.6.1. Construction Earthmoving Activities

5.6.2. Construction Earthmoving Control Strategies

5.7. Construction Paving

5.8. Construction Electricity Consumption and Emissions Factors

5.9. Operational Mobile Sources

5.9.1. Unmitigated

5.10. Operational Area Sources

5.10.1. Hearths

5.10.1.1. Unmitigated

5.10.2. Architectural Coatings

5.10.3. Landscape Equipment

5.11. Operational Energy Consumption

5.11.1. Unmitigated

5.12. Operational Water and Wastewater Consumption

5.12.1. Unmitigated

5.13. Operational Waste Generation

5.13.1. Unmitigated

5.14. Operational Refrigeration and Air Conditioning Equipment

5.14.1. Unmitigated

5.15. Operational Off-Road Equipment

5.15.1. Unmitigated

5.16. Stationary Sources

5.16.1. Emergency Generators and Fire Pumps

5.16.2. Process Boilers

5.17. User Defined

5.18. Vegetation

5.18.1. Land Use Change

5.18.1.1. Unmitigated

5.18.1. Biomass Cover Type

5.18.1.1. Unmitigated

5.18.2. Sequestration

5.18.2.1. Unmitigated

6. Climate Risk Detailed Report

6.1. Climate Risk Summary

6.2. Initial Climate Risk Scores

6.3. Adjusted Climate Risk Scores

6.4. Climate Risk Reduction Measures

7. Health and Equity Details

7.1. CalEnviroScreen 4.0 Scores

7.2. Healthy Places Index Scores

7.3. Overall Health & Equity Scores

7.4. Health & Equity Measures

7.5. Evaluation Scorecard

7.6. Health & Equity Custom Measures

8. User Changes to Default Data

# 1. Basic Project Information

## 1.1. Basic Project Information

Data Field	Value
Project Name	RPCA Sunrise Road Solar Project
Construction Start Date	1/1/2025
Operational Year	2026
Lead Agency	—
Land Use Scale	Project/site
Analysis Level for Defaults	County
Windspeed (m/s)	4.80
Precipitation (days)	2.00
Location	35.00080149908012, -117.62648263428785
County	San Bernardino-Mojave Desert
City	Unincorporated
Air District	Mojave Desert AQMD
Air Basin	Mojave Desert
TAZ	5101
EDFZ	10
Electric Utility	Southern California Edison
Gas Utility	Southern California Gas
App Version	2022.1.1.28

## 1.2. Land Use Types

Land Use Subtype	Size	Unit	Lot Acreage	Building Area (sq ft)	Landscape Area (sq ft)	Special Landscape Area (sq ft)	Population	Description
User Defined Industrial	59.0	User Defined Unit	59.0	2,570,040	0.00	0.00	—	—

### 1.3. User-Selected Emission Reduction Measures by Emissions Sector

No measures selected

## 2. Emissions Summary

### 2.1. Construction Emissions Compared Against Thresholds

Criteria Pollutants (lb/day for daily, ton/yr for annual) and GHGs (lb/day for daily, MT/yr for annual)

Un/Mit.	TOG	ROG	NOx	CO	SO2	PM10E	PM10D	PM10T	PM2.5E	PM2.5D	PM2.5T
Daily, Summer (Max)	—	—	—	—	—	—	—	—	—	—	—
Unmit.	3.58	3.01	23.7	37.5	0.07	0.86	3.60	4.46	0.79	0.88	1.67
Daily, Winter (Max)	—	—	—	—	—	—	—	—	—	—	—
Unmit.	4.07	3.42	28.8	34.4	0.07	1.10	8.71	9.81	1.01	3.51	4.52
Average Daily (Max)	—	—	—	—	—	—	—	—	—	—	—
Unmit.	0.61	0.51	4.16	5.87	0.01	0.15	1.16	1.31	0.14	0.43	0.56
Annual (Max)	—	—	—	—	—	—	—	—	—	—	—
Unmit.	0.11	0.09	0.76	1.07	< 0.005	0.03	0.21	0.24	0.03	0.08	0.10

### 2.2. Construction Emissions by Year, Unmitigated

Criteria Pollutants (lb/day for daily, ton/yr for annual) and GHGs (lb/day for daily, MT/yr for annual)

Year	TOG	ROG	NOx	CO	SO2	PM10E	PM10D	PM10T	PM2.5E	PM2.5D	PM2.5T
Daily - Summer (Max)	—	—	—	—	—	—	—	—	—	—	—
2026	3.58	3.01	23.7	37.5	0.07	0.86	3.60	4.46	0.79	0.88	1.67
Daily - Winter (Max)	—	—	—	—	—	—	—	—	—	—	—
2025	4.07	3.42	28.8	34.4	0.07	1.10	8.71	9.81	1.01	3.51	4.52

2026	3.91	3.29	26.9	32.6	0.07	1.02	8.71	9.73	0.94	3.51	4.45
Average Daily	—	—	—	—	—	—	—	—	—	—	—
2025	0.56	0.47	3.95	5.29	0.01	0.15	1.16	1.31	0.14	0.43	0.56
2026	0.61	0.51	4.16	5.87	0.01	0.15	0.76	0.91	0.14	0.20	0.34
Annual	—	—	—	—	—	—	—	—	—	—	—
2025	0.10	0.09	0.72	0.97	< 0.005	0.03	0.21	0.24	0.03	0.08	0.10
2026	0.11	0.09	0.76	1.07	< 0.005	0.03	0.14	0.17	0.02	0.04	0.06

## 2.4. Operations Emissions Compared Against Thresholds

Criteria Pollutants (lb/day for daily, ton/yr for annual) and GHGs (lb/day for daily, MT/yr for annual)

Un/Mit.	TOG	ROG	NOx	CO	SO2	PM10E	PM10D	PM10T	PM2.5E	PM2.5D	PM2.5T
Daily, Summer (Max)	—	—	—	—	—	—	—	—	—	—	—
Unmit.	78.2	76.6	1.28	112	0.01	0.21	0.09	0.30	0.16	0.02	0.18
Daily, Winter (Max)	—	—	—	—	—	—	—	—	—	—	—
Unmit.	58.3	58.3	0.36	0.06	< 0.005	0.01	0.09	0.10	0.01	0.02	0.03
Average Daily (Max)	—	—	—	—	—	—	—	—	—	—	—
Unmit.	68.1	67.3	0.72	55.2	0.01	0.10	0.06	0.17	0.08	0.02	0.10
Annual (Max)	—	—	—	—	—	—	—	—	—	—	—
Unmit.	12.4	12.3	0.13	10.1	< 0.005	0.02	0.01	0.03	0.01	< 0.005	0.02

## 2.5. Operations Emissions by Sector, Unmitigated

Criteria Pollutants (lb/day for daily, ton/yr for annual) and GHGs (lb/day for daily, MT/yr for annual)

Sector	TOG	ROG	NOx	CO	SO2	PM10E	PM10D	PM10T	PM2.5E	PM2.5D	PM2.5T
Daily, Summer (Max)	—	—	—	—	—	—	—	—	—	—	—
Mobile	0.01	0.01	0.34	0.05	< 0.005	0.01	0.09	0.10	0.01	0.02	0.03

Area	78.1	76.6	0.94	112	0.01	0.20	—	0.20	0.15	—	0.15
Energy	0.00	0.00	0.00	0.00	0.00	0.00	—	0.00	0.00	—	0.00
Water	—	—	—	—	—	—	—	—	—	—	—
Waste	—	—	—	—	—	—	—	—	—	—	—
Total	78.2	76.6	1.28	112	0.01	0.21	0.09	0.30	0.16	0.02	0.18
Daily, Winter (Max)	—	—	—	—	—	—	—	—	—	—	—
Mobile	0.01	0.01	0.36	0.06	< 0.005	0.01	0.09	0.10	0.01	0.02	0.03
Area	58.3	58.3	—	—	—	—	—	—	—	—	—
Energy	0.00	0.00	0.00	0.00	0.00	0.00	—	0.00	0.00	—	0.00
Water	—	—	—	—	—	—	—	—	—	—	—
Waste	—	—	—	—	—	—	—	—	—	—	—
Total	58.3	58.3	0.36	0.06	< 0.005	0.01	0.09	0.10	0.01	0.02	0.03
Average Daily	—	—	—	—	—	—	—	—	—	—	—
Mobile	< 0.005	< 0.005	0.26	0.04	< 0.005	0.01	0.06	0.07	0.01	0.02	0.02
Area	68.1	67.3	0.46	55.1	< 0.005	0.10	—	0.10	0.07	—	0.07
Energy	0.00	0.00	0.00	0.00	0.00	0.00	—	0.00	0.00	—	0.00
Water	—	—	—	—	—	—	—	—	—	—	—
Waste	—	—	—	—	—	—	—	—	—	—	—
Total	68.1	67.3	0.72	55.2	0.01	0.10	0.06	0.17	0.08	0.02	0.10
Annual	—	—	—	—	—	—	—	—	—	—	—
Mobile	< 0.005	< 0.005	0.05	0.01	< 0.005	< 0.005	0.01	0.01	< 0.005	< 0.005	< 0.005
Area	12.4	12.3	0.08	10.1	< 0.005	0.02	—	0.02	0.01	—	0.01
Energy	0.00	0.00	0.00	0.00	0.00	0.00	—	0.00	0.00	—	0.00
Water	—	—	—	—	—	—	—	—	—	—	—
Waste	—	—	—	—	—	—	—	—	—	—	—
Total	12.4	12.3	0.13	10.1	< 0.005	0.02	0.01	0.03	0.01	< 0.005	0.02

### 3. Construction Emissions Details

#### 3.1. Demolition (2025) - Unmitigated

Criteria Pollutants (lb/day for daily, ton/yr for annual) and GHGs (lb/day for daily, MT/yr for annual)

Location	TOG	ROG	NOx	CO	SO2	PM10E	PM10D	PM10T	PM2.5E	PM2.5D	PM2.5T
Onsite	—	—	—	—	—	—	—	—	—	—	—
Daily, Summer (Max)	—	—	—	—	—	—	—	—	—	—	—
Daily, Winter (Max)	—	—	—	—	—	—	—	—	—	—	—
Off-Road Equipment	2.86	2.40	22.2	19.9	0.03	0.92	—	0.92	0.84	—	0.84
Demolition	—	—	—	—	—	—	0.36	0.36	—	0.05	0.05
Onsite truck	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
Average Daily	—	—	—	—	—	—	—	—	—	—	—
Off-Road Equipment	0.12	0.10	0.91	0.82	< 0.005	0.04	—	0.04	0.03	—	0.03
Demolition	—	—	—	—	—	—	0.01	0.01	—	< 0.005	< 0.005
Onsite truck	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
Annual	—	—	—	—	—	—	—	—	—	—	—
Off-Road Equipment	0.02	0.02	0.17	0.15	< 0.005	0.01	—	0.01	0.01	—	0.01
Demolition	—	—	—	—	—	—	< 0.005	< 0.005	—	< 0.005	< 0.005
Onsite truck	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
Offsite	—	—	—	—	—	—	—	—	—	—	—
Daily, Summer (Max)	—	—	—	—	—	—	—	—	—	—	—
Daily, Winter (Max)	—	—	—	—	—	—	—	—	—	—	—
Worker	0.56	0.46	1.00	10.2	0.00	0.00	2.71	2.71	0.00	0.64	0.64



Vendor	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
Hauling	< 0.005	< 0.005	0.04	0.03	< 0.005	< 0.005	< 0.005	< 0.005	< 0.005	< 0.005	< 0.005
Average Daily	—	—	—	—	—	—	—	—	—	—	—
Worker	0.02	0.02	0.04	0.47	0.00	0.00	0.11	0.11	0.00	0.03	0.03
Vendor	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
Hauling	< 0.005	< 0.005	< 0.005	< 0.005	< 0.005	< 0.005	< 0.005	< 0.005	< 0.005	< 0.005	< 0.005
Annual	—	—	—	—	—	—	—	—	—	—	—
Worker	< 0.005	< 0.005	0.01	0.09	0.00	0.00	0.02	0.02	0.00	< 0.005	< 0.005
Vendor	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
Hauling	< 0.005	< 0.005	< 0.005	< 0.005	< 0.005	< 0.005	< 0.005	< 0.005	< 0.005	< 0.005	< 0.005

### 3.3. Site Preparation (2025) - Unmitigated

Criteria Pollutants (lb/day for daily, ton/yr for annual) and GHGs (lb/day for daily, MT/yr for annual)

Location	TOG	ROG	NOx	CO	SO2	PM10E	PM10D	PM10T	PM2.5E	PM2.5D	PM2.5T
Onsite	—	—	—	—	—	—	—	—	—	—	—
Daily, Summer (Max)	—	—	—	—	—	—	—	—	—	—	—
Daily, Winter (Max)	—	—	—	—	—	—	—	—	—	—	—
Off-Road Equipment	1.27	1.07	10.2	9.42	0.02	0.44	—	0.44	0.41	—	0.41
Dust From Material Movement	—	—	—	—	—	—	2.56	2.56	—	1.31	1.31
Onsite truck	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
Average Daily	—	—	—	—	—	—	—	—	—	—	—
Off-Road Equipment	0.09	0.07	0.70	0.65	< 0.005	0.03	—	0.03	0.03	—	0.03
Dust From Material Movement	—	—	—	—	—	—	0.18	0.18	—	0.09	0.09

Onsite truck	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
Annual	—	—	—	—	—	—	—	—	—	—	—
Off-Road Equipment	0.02	0.01	0.13	0.12	< 0.005	0.01	—	0.01	0.01	—	0.01
Dust From Material Movement	—	—	—	—	—	—	0.03	0.03	—	0.02	0.02
Onsite truck	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
Offsite	—	—	—	—	—	—	—	—	—	—	—
Daily, Summer (Max)	—	—	—	—	—	—	—	—	—	—	—
Daily, Winter (Max)	—	—	—	—	—	—	—	—	—	—	—
Worker	0.56	0.46	1.00	10.2	0.00	0.00	2.71	2.71	0.00	0.64	0.64
Vendor	0.06	0.06	2.62	0.67	0.02	0.05	0.89	0.93	0.05	0.24	0.29
Hauling	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
Average Daily	—	—	—	—	—	—	—	—	—	—	—
Worker	0.04	0.03	0.07	0.79	0.00	0.00	0.19	0.19	0.00	0.04	0.04
Vendor	< 0.005	< 0.005	0.18	0.05	< 0.005	< 0.005	0.06	0.06	< 0.005	0.02	0.02
Hauling	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
Annual	—	—	—	—	—	—	—	—	—	—	—
Worker	0.01	0.01	0.01	0.14	0.00	0.00	0.03	0.03	0.00	0.01	0.01
Vendor	< 0.005	< 0.005	0.03	0.01	< 0.005	< 0.005	0.01	0.01	< 0.005	< 0.005	< 0.005
Hauling	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

### 3.5. Grading (2025) - Unmitigated

Criteria Pollutants (lb/day for daily, ton/yr for annual) and GHGs (lb/day for daily, MT/yr for annual)

Location	TOG	ROG	NOx	CO	SO2	PM10E	PM10D	PM10T	PM2.5E	PM2.5D	PM2.5T
Onsite	—	—	—	—	—	—	—	—	—	—	—

Daily, Summer (Max)	—	—	—	—	—	—	—	—	—	—	—
Daily, Winter (Max)	—	—	—	—	—	—	—	—	—	—	—
Off-Road Equipment	3.45	2.90	25.2	23.5	0.05	1.05	—	1.05	0.97	—	0.97
Dust From Material Movement	—	—	—	—	—	—	5.11	5.11	—	2.63	2.63
Onsite truck	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
Average Daily	—	—	—	—	—	—	—	—	—	—	—
Off-Road Equipment	0.24	0.20	1.77	1.66	< 0.005	0.07	—	0.07	0.07	—	0.07
Dust From Material Movement	—	—	—	—	—	—	0.36	0.36	—	0.19	0.19
Onsite truck	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
Annual	—	—	—	—	—	—	—	—	—	—	—
Off-Road Equipment	0.04	0.04	0.32	0.30	< 0.005	0.01	—	0.01	0.01	—	0.01
Dust From Material Movement	—	—	—	—	—	—	0.07	0.07	—	0.03	0.03
Onsite truck	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
Offsite	—	—	—	—	—	—	—	—	—	—	—
Daily, Summer (Max)	—	—	—	—	—	—	—	—	—	—	—
Daily, Winter (Max)	—	—	—	—	—	—	—	—	—	—	—
Worker	0.56	0.46	1.00	10.2	0.00	0.00	2.71	2.71	0.00	0.64	0.64
Vendor	0.06	0.06	2.62	0.67	0.02	0.05	0.89	0.93	0.05	0.24	0.29
Hauling	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
Average Daily	—	—	—	—	—	—	—	—	—	—	—

Worker	0.04	0.03	0.08	0.81	0.00	0.00	0.19	0.19	0.00	0.04	0.04
Vendor	< 0.005	< 0.005	0.19	0.05	< 0.005	< 0.005	0.06	0.07	< 0.005	0.02	0.02
Hauling	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
Annual	—	—	—	—	—	—	—	—	—	—	—
Worker	0.01	0.01	0.01	0.15	0.00	0.00	0.03	0.03	0.00	0.01	0.01
Vendor	< 0.005	< 0.005	0.03	0.01	< 0.005	< 0.005	0.01	0.01	< 0.005	< 0.005	< 0.005
Hauling	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

### 3.7. Grading (2026) - Unmitigated

Criteria Pollutants (lb/day for daily, ton/yr for annual) and GHGs (lb/day for daily, MT/yr for annual)

Location	TOG	ROG	NOx	CO	SO2	PM10E	PM10D	PM10T	PM2.5E	PM2.5D	PM2.5T
Onsite	—	—	—	—	—	—	—	—	—	—	—
Daily, Summer (Max)	—	—	—	—	—	—	—	—	—	—	—
Daily, Winter (Max)	—	—	—	—	—	—	—	—	—	—	—
Off-Road Equipment	3.31	2.78	23.5	22.6	0.05	0.97	—	0.97	0.89	—	0.89
Dust From Material Movement	—	—	—	—	—	—	5.11	5.11	—	2.63	2.63
Onsite truck	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
Average Daily	—	—	—	—	—	—	—	—	—	—	—
Off-Road Equipment	0.04	0.03	0.28	0.27	< 0.005	0.01	—	0.01	0.01	—	0.01
Dust From Material Movement	—	—	—	—	—	—	0.06	0.06	—	0.03	0.03
Onsite truck	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
Annual	—	—	—	—	—	—	—	—	—	—	—

Off-Road Equipment	0.01	0.01	0.05	0.05	< 0.005	< 0.005	—	< 0.005	< 0.005	—	< 0.005
Dust From Material Movement	—	—	—	—	—	—	0.01	0.01	—	0.01	0.01
Onsite truck	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
Offsite	—	—	—	—	—	—	—	—	—	—	—
Daily, Summer (Max)	—	—	—	—	—	—	—	—	—	—	—
Daily, Winter (Max)	—	—	—	—	—	—	—	—	—	—	—
Worker	0.54	0.44	0.91	9.42	0.00	0.00	2.71	2.71	0.00	0.64	0.64
Vendor	0.06	0.06	2.51	0.59	0.02	0.05	0.89	0.93	0.05	0.24	0.29
Hauling	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
Average Daily	—	—	—	—	—	—	—	—	—	—	—
Worker	0.01	0.01	0.01	0.13	0.00	0.00	0.03	0.03	0.00	0.01	0.01
Vendor	< 0.005	< 0.005	0.03	0.01	< 0.005	< 0.005	0.01	0.01	< 0.005	< 0.005	< 0.005
Hauling	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
Annual	—	—	—	—	—	—	—	—	—	—	—
Worker	< 0.005	< 0.005	< 0.005	0.02	0.00	0.00	0.01	0.01	0.00	< 0.005	< 0.005
Vendor	< 0.005	< 0.005	0.01	< 0.005	< 0.005	< 0.005	< 0.005	< 0.005	< 0.005	< 0.005	< 0.005
Hauling	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

### 3.9. Construction/Installation (2026) - Unmitigated

Criteria Pollutants (lb/day for daily, ton/yr for annual) and GHGs (lb/day for daily, MT/yr for annual)

Location	TOG	ROG	NOx	CO	SO2	PM10E	PM10D	PM10T	PM2.5E	PM2.5D	PM2.5T
Onsite	—	—	—	—	—	—	—	—	—	—	—
Daily, Summer (Max)	—	—	—	—	—	—	—	—	—	—	—
Off-Road Equipment	2.94	2.46	20.5	21.9	0.05	0.81	—	0.81	0.75	—	0.75

Onsite truck	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
Daily, Winter (Max)	—	—	—	—	—	—	—	—	—	—	—
Off-Road Equipment	2.94	2.46	20.5	21.9	0.05	0.81	—	0.81	0.75	—	0.75
Onsite truck	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
Average Daily	—	—	—	—	—	—	—	—	—	—	—
Off-Road Equipment	0.44	0.37	3.08	3.31	0.01	0.12	—	0.12	0.11	—	0.11
Onsite truck	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
Annual	—	—	—	—	—	—	—	—	—	—	—
Off-Road Equipment	0.08	0.07	0.56	0.60	< 0.005	0.02	—	0.02	0.02	—	0.02
Onsite truck	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
Offsite	—	—	—	—	—	—	—	—	—	—	—
Daily, Summer (Max)	—	—	—	—	—	—	—	—	—	—	—
Worker	0.58	0.49	0.82	15.0	0.00	0.00	2.71	2.71	0.00	0.64	0.64
Vendor	0.07	0.06	2.37	0.58	0.02	0.05	0.89	0.93	0.05	0.24	0.29
Hauling	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
Daily, Winter (Max)	—	—	—	—	—	—	—	—	—	—	—
Worker	0.54	0.44	0.91	9.42	0.00	0.00	2.71	2.71	0.00	0.64	0.64
Vendor	0.06	0.06	2.51	0.59	0.02	0.05	0.89	0.93	0.05	0.24	0.29
Hauling	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
Average Daily	—	—	—	—	—	—	—	—	—	—	—
Worker	0.08	0.07	0.15	1.62	0.00	0.00	0.41	0.41	0.00	0.10	0.10
Vendor	0.01	0.01	0.38	0.09	< 0.005	0.01	0.13	0.14	0.01	0.04	0.04
Hauling	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
Annual	—	—	—	—	—	—	—	—	—	—	—
Worker	0.01	0.01	0.03	0.29	0.00	0.00	0.07	0.07	0.00	0.02	0.02

Vendor	< 0.005	< 0.005	0.07	0.02	< 0.005	< 0.005	0.02	0.03	< 0.005	0.01	0.01
Hauling	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

### 3.11. PV vendor trips (2026) - Unmitigated

Criteria Pollutants (lb/day for daily, ton/yr for annual) and GHGs (lb/day for daily, MT/yr for annual)

Location	TOG	ROG	NOx	CO	SO2	PM10E	PM10D	PM10T	PM2.5E	PM2.5D	PM2.5T
Onsite	—	—	—	—	—	—	—	—	—	—	—
Daily, Summer (Max)	—	—	—	—	—	—	—	—	—	—	—
Off-Road Equipment	0.06	0.05	0.55	1.01	< 0.005	0.02	—	0.02	0.02	—	0.02
Onsite truck	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
Daily, Winter (Max)	—	—	—	—	—	—	—	—	—	—	—
Average Daily	—	—	—	—	—	—	—	—	—	—	—
Off-Road Equipment	0.01	< 0.005	0.05	0.09	< 0.005	< 0.005	—	< 0.005	< 0.005	—	< 0.005
Onsite truck	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
Annual	—	—	—	—	—	—	—	—	—	—	—
Off-Road Equipment	< 0.005	< 0.005	0.01	0.02	< 0.005	< 0.005	—	< 0.005	< 0.005	—	< 0.005
Onsite truck	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
Offsite	—	—	—	—	—	—	—	—	—	—	—
Daily, Summer (Max)	—	—	—	—	—	—	—	—	—	—	—
Worker	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
Vendor	0.03	0.03	1.15	0.23	0.01	0.02	0.46	0.48	0.02	0.13	0.15
Hauling	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
Daily, Winter (Max)	—	—	—	—	—	—	—	—	—	—	—
Average Daily	—	—	—	—	—	—	—	—	—	—	—

Worker	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
Vendor	< 0.005	< 0.005	0.11	0.02	< 0.005	< 0.005	0.04	0.04	< 0.005	0.01	0.01
Hauling	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
Annual	—	—	—	—	—	—	—	—	—	—	—
Worker	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
Vendor	< 0.005	< 0.005	0.02	< 0.005	< 0.005	< 0.005	0.01	0.01	< 0.005	< 0.005	< 0.005
Hauling	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

### 3.13. Paving (Access Road Installation) (2026) - Unmitigated

Criteria Pollutants (lb/day for daily, ton/yr for annual) and GHGs (lb/day for daily, MT/yr for annual)

Location	TOG	ROG	NOx	CO	SO2	PM10E	PM10D	PM10T	PM2.5E	PM2.5D	PM2.5T
Onsite	—	—	—	—	—	—	—	—	—	—	—
Daily, Summer (Max)	—	—	—	—	—	—	—	—	—	—	—
Daily, Winter (Max)	—	—	—	—	—	—	—	—	—	—	—
Off-Road Equipment	0.16	0.14	1.49	2.05	< 0.005	0.07	—	0.07	0.06	—	0.06
Architectural Coatings	0.00	0.00	—	—	—	—	—	—	—	—	—
Paving	0.00	0.00	—	—	—	—	—	—	—	—	—
Onsite truck	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
Average Daily	—	—	—	—	—	—	—	—	—	—	—
Off-Road Equipment	< 0.005	< 0.005	0.04	0.06	< 0.005	< 0.005	—	< 0.005	< 0.005	—	< 0.005
Architectural Coatings	0.00	0.00	—	—	—	—	—	—	—	—	—
Paving	0.00	0.00	—	—	—	—	—	—	—	—	—
Onsite truck	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
Annual	—	—	—	—	—	—	—	—	—	—	—



Off-Road Equipment	< 0.005	< 0.005	0.01	0.01	< 0.005	< 0.005	—	< 0.005	< 0.005	—	< 0.005
Architectural Coatings	0.00	0.00	—	—	—	—	—	—	—	—	—
Paving	0.00	0.00	—	—	—	—	—	—	—	—	—
Onsite truck	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
Offsite	—	—	—	—	—	—	—	—	—	—	—
Daily, Summer (Max)	—	—	—	—	—	—	—	—	—	—	—
Daily, Winter (Max)	—	—	—	—	—	—	—	—	—	—	—
Worker	0.54	0.44	0.91	9.42	0.00	0.00	2.71	2.71	0.00	0.64	0.64
Vendor	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
Hauling	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
Average Daily	—	—	—	—	—	—	—	—	—	—	—
Worker	0.01	0.01	0.03	0.29	0.00	0.00	0.07	0.07	0.00	0.02	0.02
Vendor	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
Hauling	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
Annual	—	—	—	—	—	—	—	—	—	—	—
Worker	< 0.005	< 0.005	< 0.005	0.05	0.00	0.00	0.01	0.01	0.00	< 0.005	< 0.005
Vendor	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
Hauling	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

## 4. Operations Emissions Details

### 4.1. Mobile Emissions by Land Use

#### 4.1.1. Unmitigated

Criteria Pollutants (lb/day for daily, ton/yr for annual) and GHGs (lb/day for daily, MT/yr for annual)

Land Use	TOG	ROG	NOx	CO	SO2	PM10E	PM10D	PM10T	PM2.5E	PM2.5D	PM2.5T
----------	-----	-----	-----	----	-----	-------	-------	-------	--------	--------	--------

Daily, Summer (Max)	—	—	—	—	—	—	—	—	—	—	—
User Defined Industrial	0.01	0.01	0.34	0.05	< 0.005	0.01	0.09	0.10	0.01	0.02	0.03
Total	0.01	0.01	0.34	0.05	< 0.005	0.01	0.09	0.10	0.01	0.02	0.03
Daily, Winter (Max)	—	—	—	—	—	—	—	—	—	—	—
User Defined Industrial	0.01	0.01	0.36	0.06	< 0.005	0.01	0.09	0.10	0.01	0.02	0.03
Total	0.01	0.01	0.36	0.06	< 0.005	0.01	0.09	0.10	0.01	0.02	0.03
Annual	—	—	—	—	—	—	—	—	—	—	—
User Defined Industrial	< 0.005	< 0.005	0.05	0.01	< 0.005	< 0.005	0.01	0.01	< 0.005	< 0.005	< 0.005
Total	< 0.005	< 0.005	0.05	0.01	< 0.005	< 0.005	0.01	0.01	< 0.005	< 0.005	< 0.005

## 4.2. Energy

### 4.2.1. Electricity Emissions By Land Use - Unmitigated

Criteria Pollutants (lb/day for daily, ton/yr for annual) and GHGs (lb/day for daily, MT/yr for annual)

Land Use	TOG	ROG	NOx	CO	SO2	PM10E	PM10D	PM10T	PM2.5E	PM2.5D	PM2.5T
Daily, Summer (Max)	—	—	—	—	—	—	—	—	—	—	—
User Defined Industrial	—	—	—	—	—	—	—	—	—	—	—
Total	—	—	—	—	—	—	—	—	—	—	—
Daily, Winter (Max)	—	—	—	—	—	—	—	—	—	—	—
User Defined Industrial	—	—	—	—	—	—	—	—	—	—	—
Total	—	—	—	—	—	—	—	—	—	—	—
Annual	—	—	—	—	—	—	—	—	—	—	—

User Defined Industrial	—	—	—	—	—	—	—	—	—	—	—
Total	—	—	—	—	—	—	—	—	—	—	—

#### 4.2.3. Natural Gas Emissions By Land Use - Unmitigated

Criteria Pollutants (lb/day for daily, ton/yr for annual) and GHGs (lb/day for daily, MT/yr for annual)

Land Use	TOG	ROG	NOx	CO	SO2	PM10E	PM10D	PM10T	PM2.5E	PM2.5D	PM2.5T
Daily, Summer (Max)	—	—	—	—	—	—	—	—	—	—	—
User Defined Industrial	0.00	0.00	0.00	0.00	0.00	0.00	—	0.00	0.00	—	0.00
Total	0.00	0.00	0.00	0.00	0.00	0.00	—	0.00	0.00	—	0.00
Daily, Winter (Max)	—	—	—	—	—	—	—	—	—	—	—
User Defined Industrial	0.00	0.00	0.00	0.00	0.00	0.00	—	0.00	0.00	—	0.00
Total	0.00	0.00	0.00	0.00	0.00	0.00	—	0.00	0.00	—	0.00
Annual	—	—	—	—	—	—	—	—	—	—	—
User Defined Industrial	0.00	0.00	0.00	0.00	0.00	0.00	—	0.00	0.00	—	0.00
Total	0.00	0.00	0.00	0.00	0.00	0.00	—	0.00	0.00	—	0.00

#### 4.3. Area Emissions by Source

##### 4.3.1. Unmitigated

Criteria Pollutants (lb/day for daily, ton/yr for annual) and GHGs (lb/day for daily, MT/yr for annual)

Source	TOG	ROG	NOx	CO	SO2	PM10E	PM10D	PM10T	PM2.5E	PM2.5D	PM2.5T
Daily, Summer (Max)	—	—	—	—	—	—	—	—	—	—	—
Consumer Products	55.0	55.0	—	—	—	—	—	—	—	—	—

Architectural Coatings	3.26	3.26	—	—	—	—	—	—	—	—	—
Landscape Equipment	19.9	18.3	0.94	112	0.01	0.20	—	0.20	0.15	—	0.15
Total	78.1	76.6	0.94	112	0.01	0.20	—	0.20	0.15	—	0.15
Daily, Winter (Max)	—	—	—	—	—	—	—	—	—	—	—
Consumer Products	55.0	55.0	—	—	—	—	—	—	—	—	—
Architectural Coatings	3.26	3.26	—	—	—	—	—	—	—	—	—
Total	58.3	58.3	—	—	—	—	—	—	—	—	—
Annual	—	—	—	—	—	—	—	—	—	—	—
Consumer Products	10.0	10.0	—	—	—	—	—	—	—	—	—
Architectural Coatings	0.60	0.60	—	—	—	—	—	—	—	—	—
Landscape Equipment	1.79	1.65	0.08	10.1	< 0.005	0.02	—	0.02	0.01	—	0.01
Total	12.4	12.3	0.08	10.1	< 0.005	0.02	—	0.02	0.01	—	0.01

#### 4.4. Water Emissions by Land Use

##### 4.4.1. Unmitigated

Criteria Pollutants (lb/day for daily, ton/yr for annual) and GHGs (lb/day for daily, MT/yr for annual)

Land Use	TOG	ROG	NOx	CO	SO2	PM10E	PM10D	PM10T	PM2.5E	PM2.5D	PM2.5T
Daily, Summer (Max)	—	—	—	—	—	—	—	—	—	—	—
User Defined Industrial	—	—	—	—	—	—	—	—	—	—	—
Total	—	—	—	—	—	—	—	—	—	—	—

Daily, Winter (Max)	—	—	—	—	—	—	—	—	—	—	—
User Defined Industrial	—	—	—	—	—	—	—	—	—	—	—
Total	—	—	—	—	—	—	—	—	—	—	—
Annual	—	—	—	—	—	—	—	—	—	—	—
User Defined Industrial	—	—	—	—	—	—	—	—	—	—	—
Total	—	—	—	—	—	—	—	—	—	—	—

## 4.5. Waste Emissions by Land Use

### 4.5.1. Unmitigated

Criteria Pollutants (lb/day for daily, ton/yr for annual) and GHGs (lb/day for daily, MT/yr for annual)

Land Use	TOG	ROG	NOx	CO	SO2	PM10E	PM10D	PM10T	PM2.5E	PM2.5D	PM2.5T
Daily, Summer (Max)	—	—	—	—	—	—	—	—	—	—	—
User Defined Industrial	—	—	—	—	—	—	—	—	—	—	—
Total	—	—	—	—	—	—	—	—	—	—	—
Daily, Winter (Max)	—	—	—	—	—	—	—	—	—	—	—
User Defined Industrial	—	—	—	—	—	—	—	—	—	—	—
Total	—	—	—	—	—	—	—	—	—	—	—
Annual	—	—	—	—	—	—	—	—	—	—	—
User Defined Industrial	—	—	—	—	—	—	—	—	—	—	—
Total	—	—	—	—	—	—	—	—	—	—	—

## 4.6. Refrigerant Emissions by Land Use

#### 4.6.1. Unmitigated

Criteria Pollutants (lb/day for daily, ton/yr for annual) and GHGs (lb/day for daily, MT/yr for annual)

Land Use	TOG	ROG	NOx	CO	SO2	PM10E	PM10D	PM10T	PM2.5E	PM2.5D	PM2.5T
Daily, Summer (Max)	—	—	—	—	—	—	—	—	—	—	—
Total	—	—	—	—	—	—	—	—	—	—	—
Daily, Winter (Max)	—	—	—	—	—	—	—	—	—	—	—
Total	—	—	—	—	—	—	—	—	—	—	—
Annual	—	—	—	—	—	—	—	—	—	—	—
Total	—	—	—	—	—	—	—	—	—	—	—

#### 4.7. Offroad Emissions By Equipment Type

##### 4.7.1. Unmitigated

Criteria Pollutants (lb/day for daily, ton/yr for annual) and GHGs (lb/day for daily, MT/yr for annual)

Equipment Type	TOG	ROG	NOx	CO	SO2	PM10E	PM10D	PM10T	PM2.5E	PM2.5D	PM2.5T
Daily, Summer (Max)	—	—	—	—	—	—	—	—	—	—	—
Total	—	—	—	—	—	—	—	—	—	—	—
Daily, Winter (Max)	—	—	—	—	—	—	—	—	—	—	—
Total	—	—	—	—	—	—	—	—	—	—	—
Annual	—	—	—	—	—	—	—	—	—	—	—
Total	—	—	—	—	—	—	—	—	—	—	—

#### 4.8. Stationary Emissions By Equipment Type

##### 4.8.1. Unmitigated

Criteria Pollutants (lb/day for daily, ton/yr for annual) and GHGs (lb/day for daily, MT/yr for annual)

Equipment Type	TOG	ROG	NOx	CO	SO2	PM10E	PM10D	PM10T	PM2.5E	PM2.5D	PM2.5T
Daily, Summer (Max)	—	—	—	—	—	—	—	—	—	—	—
Total	—	—	—	—	—	—	—	—	—	—	—
Daily, Winter (Max)	—	—	—	—	—	—	—	—	—	—	—
Total	—	—	—	—	—	—	—	—	—	—	—
Annual	—	—	—	—	—	—	—	—	—	—	—
Total	—	—	—	—	—	—	—	—	—	—	—

4.9. User Defined Emissions By Equipment Type

4.9.1. Unmitigated

Criteria Pollutants (lb/day for daily, ton/yr for annual) and GHGs (lb/day for daily, MT/yr for annual)

Equipment Type	TOG	ROG	NOx	CO	SO2	PM10E	PM10D	PM10T	PM2.5E	PM2.5D	PM2.5T
Daily, Summer (Max)	—	—	—	—	—	—	—	—	—	—	—
Total	—	—	—	—	—	—	—	—	—	—	—
Daily, Winter (Max)	—	—	—	—	—	—	—	—	—	—	—
Total	—	—	—	—	—	—	—	—	—	—	—
Annual	—	—	—	—	—	—	—	—	—	—	—
Total	—	—	—	—	—	—	—	—	—	—	—

4.10. Soil Carbon Accumulation By Vegetation Type

4.10.1. Soil Carbon Accumulation By Vegetation Type - Unmitigated

Criteria Pollutants (lb/day for daily, ton/yr for annual) and GHGs (lb/day for daily, MT/yr for annual)

Vegetation	TOG	ROG	NOx	CO	SO2	PM10E	PM10D	PM10T	PM2.5E	PM2.5D	PM2.5T
Daily, Summer (Max)	—	—	—	—	—	—	—	—	—	—	—
Total	—	—	—	—	—	—	—	—	—	—	—
Daily, Winter (Max)	—	—	—	—	—	—	—	—	—	—	—
Total	—	—	—	—	—	—	—	—	—	—	—
Annual	—	—	—	—	—	—	—	—	—	—	—
Total	—	—	—	—	—	—	—	—	—	—	—

4.10.2. Above and Belowground Carbon Accumulation by Land Use Type - Unmitigated

Criteria Pollutants (lb/day for daily, ton/yr for annual) and GHGs (lb/day for daily, MT/yr for annual)

Land Use	TOG	ROG	NOx	CO	SO2	PM10E	PM10D	PM10T	PM2.5E	PM2.5D	PM2.5T
Daily, Summer (Max)	—	—	—	—	—	—	—	—	—	—	—
Total	—	—	—	—	—	—	—	—	—	—	—
Daily, Winter (Max)	—	—	—	—	—	—	—	—	—	—	—
Total	—	—	—	—	—	—	—	—	—	—	—
Annual	—	—	—	—	—	—	—	—	—	—	—
Total	—	—	—	—	—	—	—	—	—	—	—

4.10.3. Avoided and Sequestered Emissions by Species - Unmitigated

Criteria Pollutants (lb/day for daily, ton/yr for annual) and GHGs (lb/day for daily, MT/yr for annual)

Species	TOG	ROG	NOx	CO	SO2	PM10E	PM10D	PM10T	PM2.5E	PM2.5D	PM2.5T
Daily, Summer (Max)	—	—	—	—	—	—	—	—	—	—	—
Avoided	—	—	—	—	—	—	—	—	—	—	—
Subtotal	—	—	—	—	—	—	—	—	—	—	—
Sequestered	—	—	—	—	—	—	—	—	—	—	—



Subtotal	—	—	—	—	—	—	—	—	—	—	—
Removed	—	—	—	—	—	—	—	—	—	—	—
Subtotal	—	—	—	—	—	—	—	—	—	—	—
—	—	—	—	—	—	—	—	—	—	—	—
Daily, Winter (Max)	—	—	—	—	—	—	—	—	—	—	—
Avoided	—	—	—	—	—	—	—	—	—	—	—
Subtotal	—	—	—	—	—	—	—	—	—	—	—
Sequestered	—	—	—	—	—	—	—	—	—	—	—
Subtotal	—	—	—	—	—	—	—	—	—	—	—
Removed	—	—	—	—	—	—	—	—	—	—	—
Subtotal	—	—	—	—	—	—	—	—	—	—	—
—	—	—	—	—	—	—	—	—	—	—	—
Annual	—	—	—	—	—	—	—	—	—	—	—
Avoided	—	—	—	—	—	—	—	—	—	—	—
Subtotal	—	—	—	—	—	—	—	—	—	—	—
Sequestered	—	—	—	—	—	—	—	—	—	—	—
Subtotal	—	—	—	—	—	—	—	—	—	—	—
Removed	—	—	—	—	—	—	—	—	—	—	—
Subtotal	—	—	—	—	—	—	—	—	—	—	—
—	—	—	—	—	—	—	—	—	—	—	—

## 5. Activity Data

### 5.1. Construction Schedule

Phase Name	Phase Type	Start Date	End Date	Days Per Week	Work Days per Phase	Phase Description
Demolition	Demolition	10/1/2025	10/21/2025	5.00	15.0	—
Site Preparation	Site Preparation	10/22/2025	11/25/2025	5.00	25.0	—

Grading	Grading	11/26/2025	1/6/2026	5.00	30.0	—
Construction/Installation	Building Construction	1/25/2026	4/12/2026	5.00	55.0	—
PV vendor trips	Building Construction	4/13/2026	5/28/2026	5.00	34.0	—
Paving (Access Road Installation)	Paving	1/10/2026	1/24/2026	5.00	10.0	—

## 5.2. Off-Road Equipment

### 5.2.1. Unmitigated

Phase Name	Equipment Type	Fuel Type	Engine Tier	Number per Day	Hours Per Day	Horsepower	Load Factor
Demolition	Rubber Tired Dozers	Diesel	Average	2.00	8.00	367	0.40
Demolition	Excavators	Diesel	Average	3.00	8.00	36.0	0.38
Demolition	Concrete/Industrial Saws	Diesel	Average	1.00	8.00	33.0	0.73
Site Preparation	Rubber Tired Dozers	Diesel	Average	1.00	8.00	367	0.40
Site Preparation	Tractors/Loaders/Back hoes	Diesel	Average	1.00	8.00	84.0	0.37
Grading	Excavators	Diesel	Average	2.00	8.00	36.0	0.38
Grading	Rubber Tired Dozers	Diesel	Average	2.00	8.00	367	0.40
Grading	Off-Highway Trucks	Diesel	Average	1.00	8.00	376	0.38
Grading	Skid Steer Loaders	Diesel	Average	1.00	8.00	71.0	0.37
Grading	Rollers	Diesel	Average	2.00	8.00	36.0	0.38
Construction/Installation	Cranes	Diesel	Average	1.00	8.00	82.0	0.20
Construction/Installation	Other Construction Equipment	Diesel	Average	2.00	8.00	14.0	0.74
Construction/Installation	Bore/Drill Rigs	Diesel	Average	1.00	7.00	367	0.29
Construction/Installation	Tractors/Loaders/Back hoes	Diesel	Average	1.00	7.00	84.0	0.37

Construction/Installation	Excavators	Diesel	Average	1.00	8.00	36.0	0.38
Construction/Installation	Off-Highway Trucks	Diesel	Average	1.00	8.00	376	0.38
Construction/Installation	Cement and Mortar Mixers	Diesel	Average	1.00	8.00	10.0	0.56
Construction/Installation	Rubber Tired Dozers	Diesel	Average	1.00	8.00	367	0.40
Construction/Installation	Trenchers	Diesel	Average	1.00	8.00	40.0	0.50
Construction/Installation	Skid Steer Loaders	Diesel	Average	2.00	8.00	71.0	0.37
PV vendor trips	Tractors/Loaders/Back hoes	Diesel	Average	1.00	8.00	82.0	0.20
Paving (Access Road Installation)	Rollers	Diesel	Average	1.00	8.00	81.0	0.42

### 5.3. Construction Vehicles

#### 5.3.1. Unmitigated

Phase Name	Trip Type	One-Way Trips per Day	Miles per Trip	Vehicle Mix
Demolition	—	—	—	—
Demolition	Worker	80.0	48.0	LDA,LDT1,LDT2
Demolition	Vendor	0.00	0.00	HHDT,MHDT
Demolition	Hauling	1.80	2.00	HHDT
Demolition	Onsite truck	0.00	0.00	HHDT
Site Preparation	—	—	—	—
Site Preparation	Worker	80.0	48.0	LDA,LDT1,LDT2
Site Preparation	Vendor	22.0	48.0	HHDT,MHDT
Site Preparation	Hauling	0.00	0.00	HHDT
Site Preparation	Onsite truck	0.00	0.00	HHDT

Grading	—	—	—	—
Grading	Worker	80.0	48.0	LDA,LDT1,LDT2
Grading	Vendor	22.0	48.0	HHDT,MHDT
Grading	Hauling	0.00	0.00	HHDT
Grading	Onsite truck	0.00	0.00	HHDT
Construction/Installation	—	—	—	—
Construction/Installation	Worker	80.0	48.0	LDA,LDT1,LDT2
Construction/Installation	Vendor	22.0	48.0	HHDT,MHDT
Construction/Installation	Hauling	0.00	0.00	HHDT
Construction/Installation	Onsite truck	0.00	0.00	HHDT
PV vendor trips	—	—	—	—
PV vendor trips	Worker	0.00	0.00	LDA,LDT1,LDT2
PV vendor trips	Vendor	4.00	136	HHDT,MHDT
PV vendor trips	Hauling	0.00	0.00	HHDT
PV vendor trips	Onsite truck	0.00	0.00	HHDT
Paving (Access Road Installation)	—	—	—	—
Paving (Access Road Installation)	Worker	80.0	48.0	LDA,LDT1,LDT2
Paving (Access Road Installation)	Vendor	0.00	0.00	HHDT,MHDT
Paving (Access Road Installation)	Hauling	0.00	0.00	HHDT
Paving (Access Road Installation)	Onsite truck	0.00	0.00	HHDT

## 5.4. Vehicles

### 5.4.1. Construction Vehicle Control Strategies

Non-applicable. No control strategies activated by user.

## 5.5. Architectural Coatings

Phase Name	Residential Interior Area Coated (sq ft)	Residential Exterior Area Coated (sq ft)	Non-Residential Interior Area Coated (sq ft)	Non-Residential Exterior Area Coated (sq ft)	Parking Area Coated (sq ft)
------------	--	--	--	--	-----------------------------

Paving (Access Road Installation)	0.00	0.00	0.00	0.00	—
-----------------------------------	------	------	------	------	---

## 5.6. Dust Mitigation

### 5.6.1. Construction Earthmoving Activities

Phase Name	Material Imported (cy)	Material Exported (cy)	Acres Graded (acres)	Material Demolished (Building Square Footage)	Acres Paved (acres)
Demolition	0.00	0.00	0.00	7,932	—
Site Preparation	—	—	12.5	0.00	—
Grading	—	—	30.0	0.00	—
Paving (Access Road Installation)	0.00	0.00	0.00	0.00	0.00

### 5.6.2. Construction Earthmoving Control Strategies

Control Strategies Applied	Frequency (per day)	PM10 Reduction	PM2.5 Reduction
Water Exposed Area	2	61%	61%
Water Demolished Area	2	36%	36%

## 5.7. Construction Paving

Land Use	Area Paved (acres)	% Asphalt
User Defined Industrial	0.00	0%

## 5.8. Construction Electricity Consumption and Emissions Factors

### kWh per Year and Emission Factor (lb/MWh)

Year	kWh per Year	CO2	CH4	N2O
2025	0.00	532	0.03	< 0.005
2026	0.00	532	0.03	< 0.005

## 5.9. Operational Mobile Sources

### 5.9.1. Unmitigated

Land Use Type	Trips/Weekday	Trips/Saturday	Trips/Sunday	Trips/Year	VMT/Weekday	VMT/Saturday	VMT/Sunday	VMT/Year
User Defined Industrial	3.00	0.00	0.00	782	100	0.00	0.00	26,073

## 5.10. Operational Area Sources

### 5.10.1. Hearths

#### 5.10.1.1. Unmitigated

### 5.10.2. Architectural Coatings

Residential Interior Area Coated (sq ft)	Residential Exterior Area Coated (sq ft)	Non-Residential Interior Area Coated (sq ft)	Non-Residential Exterior Area Coated (sq ft)	Parking Area Coated (sq ft)
0	0.00	3,855,060	1,285,020	—

### 5.10.3. Landscape Equipment

Season	Unit	Value
Snow Days	day/yr	0.00
Summer Days	day/yr	180

## 5.11. Operational Energy Consumption

### 5.11.1. Unmitigated

#### Electricity (kWh/yr) and CO2 and CH4 and N2O and Natural Gas (kBTU/yr)

Land Use	Electricity (kWh/yr)	CO2	CH4	N2O	Natural Gas (kBTU/yr)
User Defined Industrial	0.00	532	0.0330	0.0040	0.00

## 5.12. Operational Water and Wastewater Consumption

### 5.12.1. Unmitigated

Land Use	Indoor Water (gal/year)	Outdoor Water (gal/year)
User Defined Industrial	0.00	0.00

## 5.13. Operational Waste Generation

### 5.13.1. Unmitigated

Land Use	Waste (ton/year)	Cogeneration (kWh/year)
User Defined Industrial	0.00	—

## 5.14. Operational Refrigeration and Air Conditioning Equipment

### 5.14.1. Unmitigated

Land Use Type	Equipment Type	Refrigerant	GWP	Quantity (kg)	Operations Leak Rate	Service Leak Rate	Times Serviced
---------------	----------------	-------------	-----	---------------	----------------------	-------------------	----------------

## 5.15. Operational Off-Road Equipment

### 5.15.1. Unmitigated

Equipment Type	Fuel Type	Engine Tier	Number per Day	Hours Per Day	Horsepower	Load Factor
----------------	-----------	-------------	----------------	---------------	------------	-------------

## 5.16. Stationary Sources

### 5.16.1. Emergency Generators and Fire Pumps

Equipment Type	Fuel Type	Number per Day	Hours per Day	Hours per Year	Horsepower	Load Factor
----------------	-----------	----------------	---------------	----------------	------------	-------------

### 5.16.2. Process Boilers

Equipment Type	Fuel Type	Number	Boiler Rating (MMBtu/hr)	Daily Heat Input (MMBtu/day)	Annual Heat Input (MMBtu/yr)
----------------	-----------	--------	--------------------------	------------------------------	------------------------------

### 5.17. User Defined

Equipment Type	Fuel Type
----------------	-----------

### 5.18. Vegetation

#### 5.18.1. Land Use Change

##### 5.18.1.1. Unmitigated

Vegetation Land Use Type	Vegetation Soil Type	Initial Acres	Final Acres
--------------------------	----------------------	---------------	-------------

#### 5.18.1. Biomass Cover Type

##### 5.18.1.1. Unmitigated

Biomass Cover Type	Initial Acres	Final Acres
--------------------	---------------	-------------

#### 5.18.2. Sequestration

##### 5.18.2.1. Unmitigated

Tree Type	Number	Electricity Saved (kWh/year)	Natural Gas Saved (btu/year)
-----------	--------	------------------------------	------------------------------

## 6. Climate Risk Detailed Report

### 6.1. Climate Risk Summary

Cal-Adapt midcentury 2040–2059 average projections for four hazards are reported below for your project location. These are under Representation Concentration Pathway (RCP) 8.5 which assumes GHG emissions will continue to rise strongly through 2050 and then plateau around 2100.



Climate Hazard	Result for Project Location	Unit
Temperature and Extreme Heat	31.6	annual days of extreme heat
Extreme Precipitation	0.10	annual days with precipitation above 20 mm
Sea Level Rise	—	meters of inundation depth
Wildfire	0.53	annual hectares burned

Temperature and Extreme Heat data are for grid cell in which your project are located. The projection is based on the 98th historical percentile of daily maximum/minimum temperatures from observed historical data (32 climate model ensemble from Cal-Adapt, 2040–2059 average under RCP 8.5). Each grid cell is 6 kilometers (km) by 6 km, or 3.7 miles (mi) by 3.7 mi.

Extreme Precipitation data are for the grid cell in which your project are located. The threshold of 20 mm is equivalent to about ¾ an inch of rain, which would be light to moderate rainfall if received over a full day or heavy rain if received over a period of 2 to 4 hours. Each grid cell is 6 kilometers (km) by 6 km, or 3.7 miles (mi) by 3.7 mi.

Sea Level Rise data are for the grid cell in which your project are located. The projections are from Radke et al. (2017), as reported in Cal-Adapt (Radke et al., 2017, CEC-500-2017-008), and consider inundation location and depth for the San Francisco Bay, the Sacramento-San Joaquin River Delta and California coast resulting different increments of sea level rise coupled with extreme storm events. Users may select from four scenarios to view the range in potential inundation depth for the grid cell. The four scenarios are: No rise, 0.5 meter, 1.0 meter, 1.41 meters

Wildfire data are for the grid cell in which your project are located. The projections are from UC Davis, as reported in Cal-Adapt (2040–2059 average under RCP 8.5), and consider historical data of climate, vegetation, population density, and large (> 400 ha) fire history. Users may select from four model simulations to view the range in potential wildfire probabilities for the grid cell. The four simulations make different assumptions about expected rainfall and temperature are: Warmer/drier (HadGEM2-ES), Cooler/wetter (CNRM-CM5), Average conditions (CanESM2), Range of different rainfall and temperature possibilities (MIROC5). Each grid cell is 6 kilometers (km) by 6 km, or 3.7 miles (mi) by 3.7 mi.

## 6.2. Initial Climate Risk Scores

Climate Hazard	Exposure Score	Sensitivity Score	Adaptive Capacity Score	Vulnerability Score
Temperature and Extreme Heat	3	0	0	N/A
Extreme Precipitation	N/A	N/A	N/A	N/A
Sea Level Rise	N/A	N/A	N/A	N/A
Wildfire	N/A	N/A	N/A	N/A
Flooding	N/A	N/A	N/A	N/A
Drought	0	0	0	N/A
Snowpack Reduction	N/A	N/A	N/A	N/A
Air Quality Degradation	N/A	N/A	N/A	N/A

The sensitivity score reflects the extent to which a project would be adversely affected by exposure to a climate hazard. Exposure is rated on a scale of 1 to 5, with a score of 5 representing the greatest exposure.

The adaptive capacity of a project refers to its ability to manage and reduce vulnerabilities from projected climate hazards. Adaptive capacity is rated on a scale of 1 to 5, with a score of 5 representing the greatest ability to adapt.

The overall vulnerability scores are calculated based on the potential impacts and adaptive capacity assessments for each hazard. Scores do not include implementation of climate risk reduction measures.

### 6.3. Adjusted Climate Risk Scores

Climate Hazard	Exposure Score	Sensitivity Score	Adaptive Capacity Score	Vulnerability Score
Temperature and Extreme Heat	3	1	1	3
Extreme Precipitation	N/A	N/A	N/A	N/A
Sea Level Rise	N/A	N/A	N/A	N/A
Wildfire	N/A	N/A	N/A	N/A
Flooding	N/A	N/A	N/A	N/A
Drought	1	1	1	2
Snowpack Reduction	N/A	N/A	N/A	N/A
Air Quality Degradation	N/A	N/A	N/A	N/A

The sensitivity score reflects the extent to which a project would be adversely affected by exposure to a climate hazard. Exposure is rated on a scale of 1 to 5, with a score of 5 representing the greatest exposure.

The adaptive capacity of a project refers to its ability to manage and reduce vulnerabilities from projected climate hazards. Adaptive capacity is rated on a scale of 1 to 5, with a score of 5 representing the greatest ability to adapt.

The overall vulnerability scores are calculated based on the potential impacts and adaptive capacity assessments for each hazard. Scores include implementation of climate risk reduction measures.

### 6.4. Climate Risk Reduction Measures

## 7. Health and Equity Details

### 7.1. CalEnviroScreen 4.0 Scores

The maximum CalEnviroScreen score is 100. A high score (i.e., greater than 50) reflects a higher pollution burden compared to other census tracts in the state.

Indicator	Result for Project Census Tract
Exposure Indicators	—
AQ-Ozone	82.7
AQ-PM	6.66
AQ-DPM	4.93
Drinking Water	78.5
Lead Risk Housing	26.1

Pesticides	29.6
Toxic Releases	8.06
Traffic	8.85
Effect Indicators	—
CleanUp Sites	90.1
Groundwater	82.8
Haz Waste Facilities/Generators	95.0
Impaired Water Bodies	0.00
Solid Waste	84.9
Sensitive Population	—
Asthma	78.8
Cardio-vascular	75.6
Low Birth Weights	56.4
Socioeconomic Factor Indicators	—
Education	43.4
Housing	27.2
Linguistic	2.81
Poverty	45.5
Unemployment	49.9

## 7.2. Healthy Places Index Scores

The maximum Health Places Index score is 100. A high score (i.e., greater than 50) reflects healthier community conditions compared to other census tracts in the state.

Indicator	Result for Project Census Tract
Economic	—
Above Poverty	53.2144232
Employed	9.919158219
Median HI	58.10342615
Education	—

Bachelor's or higher	42.08905428
High school enrollment	5.042987296
Preschool enrollment	56.08879764
Transportation	—
Auto Access	78.96830489
Active commuting	1.039394328
Social	—
2-parent households	78.08289491
Voting	77.55678173
Neighborhood	—
Alcohol availability	81.26523803
Park access	14.731169
Retail density	1.206210702
Supermarket access	20.5825741
Tree canopy	8.725779546
Housing	—
Homeownership	69.22879507
Housing habitability	84.72988579
Low-inc homeowner severe housing cost burden	63.63403054
Low-inc renter severe housing cost burden	81.17541383
Uncrowded housing	60.05389452
Health Outcomes	—
Insured adults	72.56512255
Arthritis	0.0
Asthma ER Admissions	32.4
High Blood Pressure	0.0
Cancer (excluding skin)	0.0
Asthma	0.0

Coronary Heart Disease	0.0
Chronic Obstructive Pulmonary Disease	0.0
Diagnosed Diabetes	0.0
Life Expectancy at Birth	14.0
Cognitively Disabled	18.3
Physically Disabled	22.7
Heart Attack ER Admissions	4.2
Mental Health Not Good	0.0
Chronic Kidney Disease	0.0
Obesity	0.0
Pedestrian Injuries	68.4
Physical Health Not Good	0.0
Stroke	0.0
Health Risk Behaviors	—
Binge Drinking	0.0
Current Smoker	0.0
No Leisure Time for Physical Activity	0.0
Climate Change Exposures	—
Wildfire Risk	0.0
SLR Inundation Area	0.0
Children	25.4
Elderly	16.5
English Speaking	76.5
Foreign-born	5.1
Outdoor Workers	19.8
Climate Change Adaptive Capacity	—
Impervious Surface Cover	89.5
Traffic Density	9.3

Traffic Access	23.0
Other Indices	—
Hardship	58.2
Other Decision Support	—
2016 Voting	78.1

### 7.3. Overall Health & Equity Scores

Metric	Result for Project Census Tract
CalEnviroScreen 4.0 Score for Project Location (a)	57.0
Healthy Places Index Score for Project Location (b)	41.0
Project Located in a Designated Disadvantaged Community (Senate Bill 535)	No
Project Located in a Low-Income Community (Assembly Bill 1550)	No
Project Located in a Community Air Protection Program Community (Assembly Bill 617)	No

a: The maximum CalEnviroScreen score is 100. A high score (i.e., greater than 50) reflects a higher pollution burden compared to other census tracts in the state.

b: The maximum Health Places Index score is 100. A high score (i.e., greater than 50) reflects healthier community conditions compared to other census tracts in the state.

### 7.4. Health & Equity Measures

No Health & Equity Measures selected.

### 7.5. Evaluation Scorecard

Health & Equity Evaluation Scorecard not completed.

### 7.6. Health & Equity Custom Measures

No Health & Equity Custom Measures created.

## 8. User Changes to Default Data

Screen	Justification
Land Use	changes according to project description
Construction: Construction Phases	Project construction schedule
Construction: Off-Road Equipment	changes according to project assumptions.

Construction: Trips and VMT	project assumptions
Construction: Architectural Coatings	No architectural coating.
Operations: Vehicle Data	Changes according to Project assumptions.
Operations: Fleet Mix	changes according to Project assumptions